

THE ENGINEER AND HIS CONSULTANTS DO NOT WARRANT OR GUARANTEE THE ACCURACY AND COMPLETENESS OF THE DELIVERABLES HEREIN BEYOND A REASONABLE DILIGENCE. IF ANY MISTAKES, OMISSIONS, OR DISCREPANCIES ARE FOUND TO EXIST WITHIN THE DELIVERABLES, THE ENGINEER SHALL BE PROMPTLY NOTIFIED SO THAT HE MAY HAVE THE OPPORTUNITY TO TAKE WHATEVER STEPS NECESSARY TO RESOLVE THEM. FAILURE TO PROMPTLY NOTIFY THE ENGINEER OF SUCH CONDITIONS SHALL ABSOLVE THE ENGINEER FROM ANY RESPONSIBILITY FOR THE CONSEQUENCES OF SUCH FAILURE. ACTIONS TAKEN WITHOUT THE KNOWLEDGE AND CONSENT TO THE ENGINEER OR IN CONTRADICTION TO THE ENGINEER'S DELIVERABLES OR RECOMMENDATIONS SHALL BECOME THE RESPONSIBILITY NOT OF THE ENGINEER BUT OF THE PARTIES RESPONSIBLE FOR TAKING SUCH ACTION.

PLANS PREPARED FOR
TAYLOR MORRISON
 1834 WALDEN OFFICE SQUARE, SUITE 300
 SCHAUMBURG, ILLINOIS 60173
 (847) 925-1400

FINAL ENGINEERING PLANS

FOR

SIGWALT 16

45 S. CHESTNUT AVE

ARLINGTON HEIGHTS, ILLINOIS

LEGEND

	EXISTING	PROPOSED
SANITARY MANHOLE	⊙	⊙
STORM MANHOLE	⊙	⊙
CATCH BASIN	□	■
INLET	○	●
PRECAST FLARED END SECTION	▽	▶
CONCRETE HEADWALL	∪	∩
VALVE VAULT	⊕	⊕
VALVE BOX	⊕	⊕
FIRE HYDRANT	⊕	⊕
BUFFALO BOX	⊕	⊕
CLEANOUT	⊕	⊕
SANITARY SEWER	—	—
FORCE MAIN	—	—
STORM SEWER	—	—
WATER MAIN	—	—
CONSTRUCT WATER MAIN UNDER SEWER	—	—
GRANULAR TRENCH BACKFILL	—	—
STREET LIGHT	—	—
ELECTRICAL CABLE	—	—
2" CONDUIT ENCASEMENT	—	—
ELECTRICAL TRANSFORMER OR PEDESTAL	—	—
POWER POLE	—	—
STREET SIGN	—	—
GAS MAIN	—	—
TELEPHONE LINE	—	—
CONTOUR	—	—
SPOT ELEVATION	X (750.00)	X 750.00
WETLANDS	—	—
FLOODWAY	—	—
FLOODPLAIN	—	—
HIGH WATER LEVEL (HWL)	—	—
NORMAL WATER LEVEL (NWL)	—	—
DIRECTION OF SURFACE FLOW	—	—
DITCH OR SWALE	—	—
OVERFLOW RELIEF ROUTING	—	—
SLOPE BANK	—	—
TREE WITH TRUNK SIZE	—	—
SOIL BORING	—	—
TOPSOIL PROBE	—	—
FENCE LINE, WIRE OR SILT	—	—
FENCE LINE, CHAIN LINK OR IRON	—	—
FENCE LINE, WOOD OR PLASTIC	—	—
CONCRETE SIDEWALK	—	—
CURB AND GUTTER	—	—
DEPRESSED CURB	—	—
REVERSE PITCH CURB & GUTTER	—	—
EASEMENT LINE	—	—


CONTACTS

VILLAGE OF ARLINGTON HEIGHTS
 Community Development: (847) 368-5200
 Address
 City, State ZIP

Public Works Department: (847) 368-5800
 222 N Ridge Ave.
 Arlington Heights, IL 60005

JULIE
 Underground Utility Locations
 1-800-892-0123
 811

LOCATION MAP

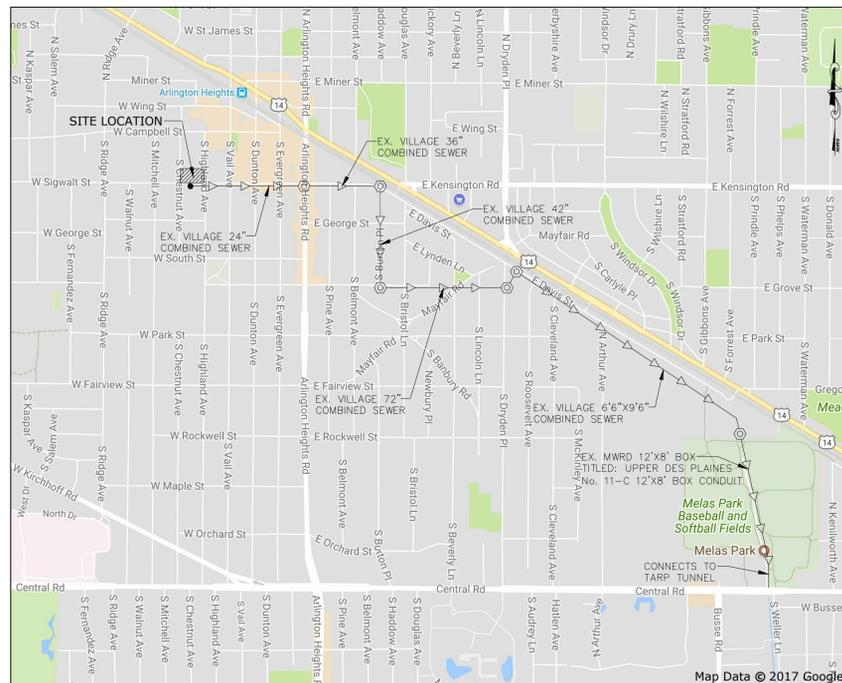

INDEX OF SHEETS

- TITLE SHEET
- EXISTING CONDITIONS PLAN
- DEMOLITION PLAN
- SITE GEOMETRIC AND PAVING PLAN
- SOIL EROSION AND SEDIMENT CONTROL (SESC) PLAN
- GRADING PLAN
- UTILITY PLAN
- PROJECT NOTES AND SPECIFICATIONS
- CONSTRUCTION DETAILS AND STANDARDS
- CONSTRUCTION DETAILS AND STANDARDS

NOTE:
 COORDINATES AT LOT CORNERS SHOWN HEREON ARE REFERENCED TO ILLINOIS STATE PLANE SYSTEM COORDINATES, EAST ZONE. ESTABLISHED THROUGH VRS TRIMBLE NETWORK.

NORTHWEST CORNER:
 N 1972496.90, E 1078414.44

SOUTHWEST CORNER:
 N 1972346.89, E 1078414.32

NORTHEAST CORNER:
 N 1972496.83, E 1078678.07

SOUTHEAST CORNER:
 N 1972346.82, E 1078677.83

GENERAL NOTES

- The contractor shall notify the following governmental agencies at least two working days prior to commencement of construction:
 - Village of Arlington Heights Public Works Department (847-368-5800)
 - MWRD Local Sewer System Sections Field Office (708-588-4055)
- The contractor shall notify all utility companies and arrange for their facilities to be located prior to work in any easement, right-of-way, or suspected utility location. Repair of any damage to existing facilities shall be the responsibility of the contractor. Utility locations shown herein are for graphic illustration only and are not to be relied upon.
- Prior to commencement of any offsite construction, the contractor shall secure written authorization that all offsite easements have been secured, and that permission has been granted to enter onto private property.
- Elevations shown herein reflect NAVD 1988 datum.
- The boundary and topographic survey data for this project is based on a field survey prepared by Professional Associated Survey, Inc., dated February 13, 2017, and updated boundary survey prepared by Thomson Surveying, Ltd, dated 3-11-19. The contractor shall verify existing conditions prior to commencing construction and shall immediately notify the engineer in writing of any differing conditions.
- RWG Engineering, LLC, its employees and agents are not responsible for the safety of any party at or on the construction site. Safety is the sole responsibility of the contractor, and any other entity performing work at the site. Neither the owner nor the engineer assumes any responsibility for job site safety or for the means, methods or sequences of construction.
- Except where modified by the contract documents, all work proposed hereon shall be in accordance with the following specifications, which are hereby made a part hereof:
 - "Standard Specifications for Road and Bridge Construction in Illinois," as prepared by I.D.O.T. latest edition.
 - "Standard Specifications for Water and Sewer Main Construction in Illinois," latest edition.
 - "Illinois Recommended Standards for Sewage Works," as published by the I.E.P.A., latest edition.
 - The subdivision and development codes and standards of the Village of Arlington Heights, as published by the Municipality.
 - "Illinois Accessibility Code" as published by the State of Illinois Capital Development Board, effective April 24, 1997.
 - The National Electric Code.
 - "Illinois Urban Manual" as prepared by the U.S. Dept. of Agriculture latest edition.

"TO THE BEST OF OUR KNOWLEDGE AND BELIEF, THE DRAINAGE OF SURFACE WATERS WILL NOT BE CHANGED BY THE CONSTRUCTION OF THIS PROJECT, OR, THAT IF DRAINAGE WILL BE CHANGED, REASONABLE PROVISION HAS BEEN MADE FOR COLLECTION AND DIVERSION OF SUCH SURFACE WATERS INTO PUBLIC AREAS, OR DRAINS APPROVED FOR USE BY THE VILLAGE, AND THAT SUCH SURFACE WATERS ARE PLANNED FOR IN ACCORDANCE WITH GENERALLY ACCEPTED ENGINEERING PRACTICES SO AS TO REDUCE THE LIKELIHOOD OF DAMAGE TO ADJOINING PROPERTIES BECAUSE OF THE CONSTRUCTION OF THIS PROJECT."

MAURSEN R. MULLIGAN
 REGISTERED PROFESSIONAL ENGINEER
 EXPIRATION DATE: 11/30/19

BENCHMARKS

SOURCE BENCHMARK:
 ALTA/NSPS LAND TITLE SURVEY PROVIDED BY PROFESSIONALS ASSOCIATED SURVEY, INC.
 7100 N. TRIP AVENUE, LINCOLNWOOD, IL. 60712

SITE BENCHMARK:
 FIRE HYDRANT ON N.W. CORNER OF SIGWALT STREET AND S. HIGHLAND AVENUE. N.W. BOLT ON FIRE HYDRANT
 ELEV. = 692.99





SIGWALT 16
 ARLINGTON HEIGHTS, ILLINOIS
 TITLE SHEET

975 E. 22nd St, Suite 400
 Wheaton, IL 60189
 630-480-7889
 www.rwg-engineering.com



PROJECT NO. 42905219
 DATE 04/12/19
 SCALE NONE
 PROJ. MGR. RWG
 PROJ. ASSOC. MRM
 DRAWN BY TLM

SHEET
1 OF 10

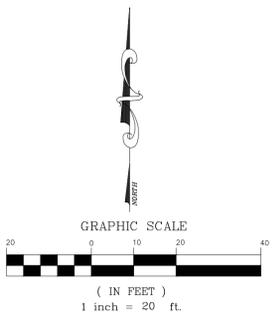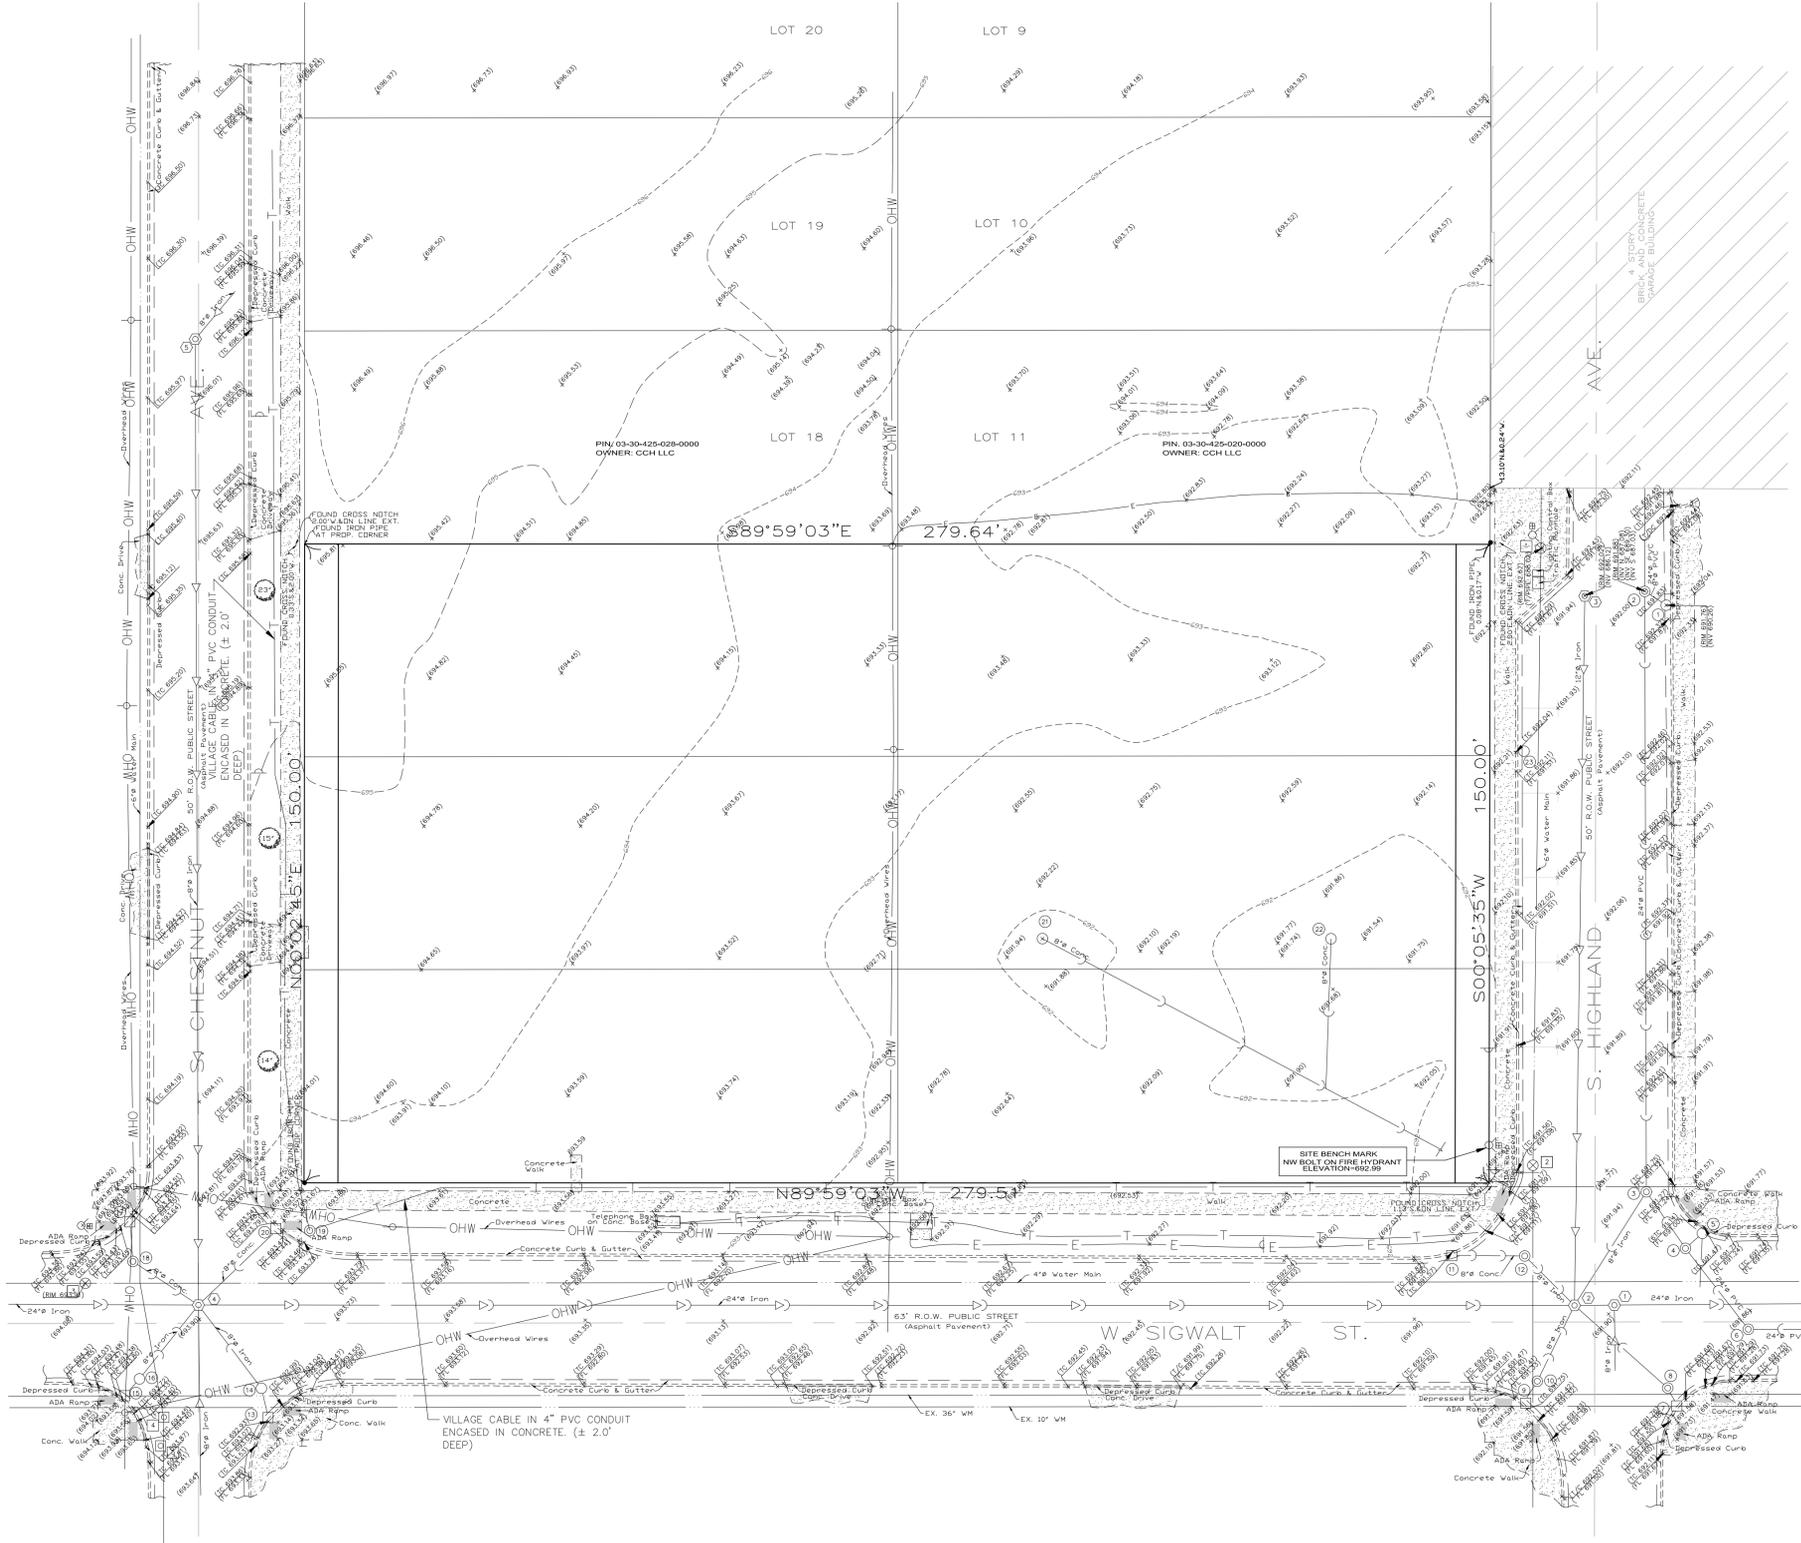

SURVEY NOTE
 THE INFORMATION SHOWN HEREON IS BASED ON A BOUNDARY AND TOPOGRAPHIC SURVEY DONE BY PROFESSIONALS ASSOCIATED SURVEY, INC. ORDER NO. 17-91627, DATED 02/13/17 & AN UPDATED BOUNDARY SURVEY PREPARED BY: THOMSON SURVEYING LTD., DATED 03/11/19.

ABBREVIATIONS LEGEND
 (IN ADDITION TO TITLE SHEET LEGEND)
 EX = EXISTING
 PR = PROPOSED
 BC = BACK OF CURB
 FC = FACE OF CURB
 EP = EDGE OF PAVEMENT
 PL = PROPERTY LINE
 FB = FACE OF BUILDING
 EC = EDGE OF CONCRETE
 RW = RETAINING WALL
 ROW = RIGHT OF WAY
 BC/BC = BACK OF CURB TO BACK OF CURB
 SW = SIDEWALK
 R = RADIUS
 (TYP) = TYPICAL

EXISTING PROPERTY DATA
 ADDRESS: 37-45 S. CHESTNUT AVE, ARLINGTON HEIGHTS
 36-40 S. HIGHLAND AVE, ARLINGTON HEIGHTS
 EXISTING ZONE:
 VC-PD (VILLAGE CENTER - PLANNED DEVELOPMENT)
 TOTAL SITE AREA BEFORE DEDICATED ROW: 41,939 SF (0.963 AC)
 TOTAL SITE AREA AFTER DEDICATED ROW: 39,539 S.F. (0.908 AC)
 PIN: 03-30-425-012-0000
 03-30-425-013-0000
 03-30-425-014-0000
 03-30-425-021-0000
 03-30-425-022-0000
 03-30-425-023-0000
 LEGAL DESCRIPTION: LOTS 12, 13, 14, 15, 16 AND 17 IN BLOCK 2 IN A SUBDIVISION OF LOTS 26, 27, 28 AND 29 IN ASSASSOR'S SUBDIVISION OF SECTION 30, TOWNSHIP 42 NORTH, RANGE 11, EAST OF THE THIRD PRINCIPAL MERIDIAN, IN COOK COUNTY, ILLINOIS

② SANITARY STRUCTURE NUMBER
 ⑪ STORM STRUCTURE NUMBER
 ⑤ WATERMAIN STRUCTURE NUMBER

EXISTING UTILITY STRUCTURE SCHEDULE

SANITARY SEWER STRUCTURES

① EX SAN M.H. RIM= 691.91 INV= 684.56 (8" S) INV= 684.26 (24" W) INV= 684.21 (24" E)	② EX SAN M.H. RIM= 691.94 INV= 686.99 (8" NE) INV= 687.04 (8" SE) INV= 688.49 (8" SW) INV= 686.84 (8" NW) INV= 684.39 (24" W) INV= 684.29 (24" E)
③ EX SAN M.H. RIM= 692.02 INV= 686.12 (12" S)	④ EX SAN M.H. RIM= 693.95 INV= 689.85 (8" SE) INV= 685.75 (8" S) INV= 689.43 (8" SW) INV= 689.55 (8" NW) INV= 687.25 (8" N) INV= 690.00 (8" NE) INV= 685.60 (24" W) INV= 685.40 (24" E)
⑤ EX SAN M.H. RIM= 696.21 INV= 690.76 (8" NE) INV= 688.73 (8" S)	

STORM SEWER STRUCTURES

① EX STM C.B. RIM= 691.76 INV= 690.26 (8" NW)	② EX STM M.H. RIM= 691.88 INV= 687.08 (24" N) INV= 689.30 (8" E) INV= 687.03 (24" S)
③ EX STM M.H. RIM= 691.49 INV= 686.67 (24" SE) INV= 686.09 (8" SW) INV= 686.59 (24" N)	④ EX STM M.H. RIM= 691.33 INV= 686.73 (24" NW) INV= 686.53 (24" SE)
⑤ EX STM C.B. RIM= 691.07 INV= 688.97 (24" SW) INV= 688.91 (24" S)	⑥ EX STM M.H. RIM= 691.83 INV= 687.03 (24" E) INV= 686.83 (24" NW)
⑦ EX STM INLET RIM= 691.26 INV= 688.40 (8" NW)	⑧ EX STM M.H. RIM= 691.55 INV= 688.50 (8" SE) INV= 688.30 (8" NW)
⑨ EX STM INLET RIM= 691.34 INV= 688.54 (8" NE)	⑩ EX STM M.H. RIM= 691.53 INV= 688.51 (8" NE)
⑪ EX STM INLET RIM= 690.97 INV= 688.27 (8" E)	⑫ EX STM M.H. RIM= 691.48 INV= 688.03 (8" W,SE)
⑬ EX STM INLET RIM= 692.87 INV= 689.97 (8" N)	⑭ EX STM C.B. RIM= 693.24 INV= 690.04 (8" SE) INV= 689.84 (8" NW)
⑮ EX STM INLET RIM= 693.28 INV= 690.48 (8" NE)	⑯ EX STM C.B. RIM= 693.50 INV= 690.40 (8" SW) INV= 690.20 (8" NE)
⑰ EX STM INLET RIM= 693.30 INV= 691.05 (8" S)	⑱ EX STM M.H. RIM= 693.68 WATER FILLED T/WATER= 690.03
⑲ EX STM M.H. RIM= 693.70	⑳ EX STM INLET RIM= 693.44 END OF PIPE SEALED
㉑ EX STM C.B. RIM= 691.68 INV= 688.88 (8" SE) UNABLE TO OPEN	㉒ EX STM C.B. RIM= 691.50 INV= 688.85 (8" S) UNABLE TO OPEN
㉓ EX STM C.B. RIM= 691.52 WATER FILLED T/WATER= 687.67	

WATERMAIN STRUCTURES

① EX VALVE VAULT RIM= 692.67 T/P= 688.02	② EX WATER M.H. RIM= 691.18 WATER FILLED T/WATER= 689.18
③ EX VALVE VAULT RIM= 693.91	④ EX CLEANOUT RIM= 693.53 T/P= 688.38
⑤ EX CLEANOUT RIM= 693.55 T/P= 688.35	

DATE: 05/07/19
 REVISIONS:
 1. 05/07/19 IN OFFICE/CLIENT REVIEW
 2. 05/17/19 VILLAGE REVIEW #1
 3. 06/06/19 VILLAGE REVIEW #2
 DRAWN BY: TLM
 TLM
 ZRN



SIGWALT 16
ARLINGTON HEIGHTS, ILLINOIS
EXISTING CONDITIONS PLAN

975 E. 22nd St, Suite 400
 Wheaton, IL 60189
 630.480.7889
 www.rwg-engineering.com



PROJECT NO. 42905219
 DATE 04/12/19
 SCALE 1"=20'
 PROJ. MGR. RWG
 PROJ. ASSOC. MRM
 DRAWN BY TLM

SHEET
2 OF 10

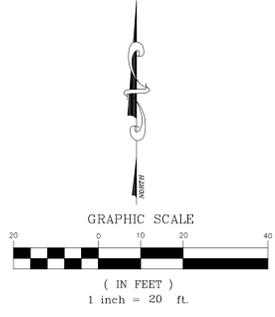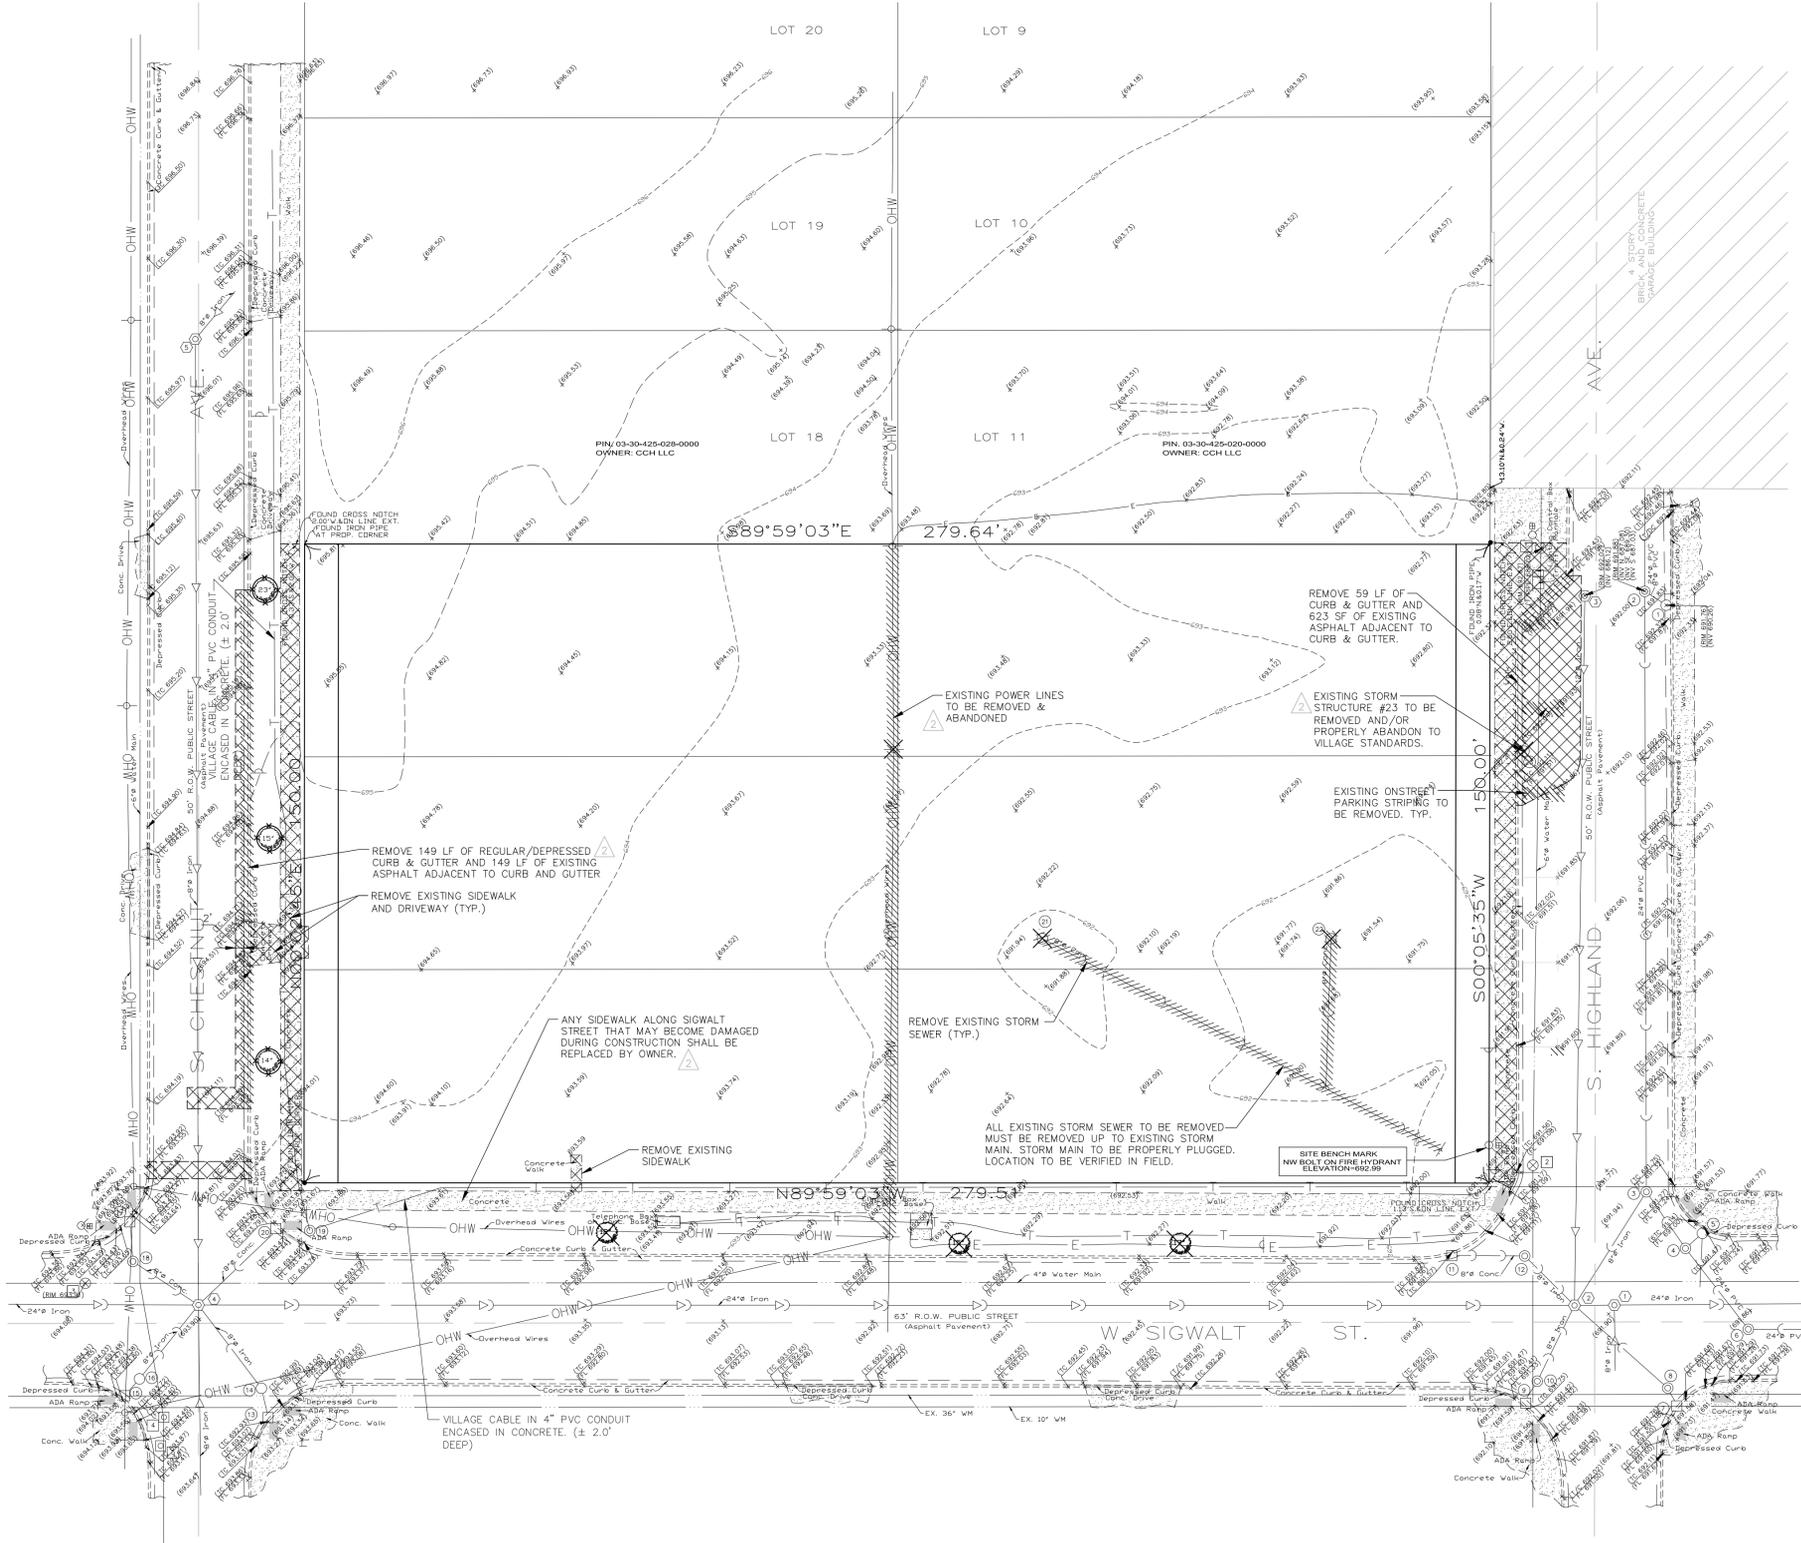

ABBREVIATIONS LEGEND
(IN ADDITION TO TITLE SHEET LEGEND)

- EX = EXISTING
- PR = PROPOSED
- BC = BACK OF CURB
- FC = FACE OF CURB
- EP = EDGE OF PAVEMENT
- PL = PROPERTY LINE
- FB = FACE OF BUILDING
- EC = EDGE OF CONCRETE
- RW = RETAINING WALL
- ROW = RIGHT OF WAY
- BC/BC = BACK OF CURB TO BACK OF CURB
- SW = SIDEWALK
- R = RADIUS
- (TYP) = TYPICAL

② SANITARY STRUCTURE NUMBER
⑪ STORM STRUCTURE NUMBER
⑤ WATERMAIN STRUCTURE NUMBER

EXISTING UTILITY STRUCTURE SCHEDULE

SANITARY SEWER STRUCTURES

1 EX SAN M.H. RIM= 691.91 INV= 684.56 (8" S) INV= 684.26 (24" W) INV= 684.21 (24" E)	2 EX SAN M.H. RIM= 691.94 INV= 686.99 (8" NE) INV= 687.04 (8" SE) INV= 688.49 (8" SW) INV= 686.84 (8" NW) INV= 684.39 (24" W) INV= 684.29 (24" E)
3 EX SAN M.H. RIM= 692.02 INV= 686.12 (12" S)	4 EX SAN M.H. RIM= 693.95 INV= 689.85 (8" SE) INV= 685.75 (8" S) INV= 689.43 (8" SW) INV= 689.55 (8" NW) INV= 687.25 (8" NE) INV= 690.00 (8" NE) INV= 685.60 (24" W) INV= 685.40 (24" E)
5 EX SAN M.H. RIM= 696.21 INV= 690.76 (8" NE) INV= 688.73 (8" S)	

STORM SEWER STRUCTURES

1 EX STM C.B. RIM= 691.76 INV= 690.26 (8" NW)	2 EX STM M.H. RIM= 691.88 INV= 687.05 (24" N) INV= 689.30 (8" E) INV= 687.03 (24" S)
3 EX STM M.H. RIM= 691.49 INV= 686.67 (24" SE) INV= 686.09 (8" SW) INV= 686.59 (24" N)	4 EX STM M.H. RIM= 691.33 INV= 686.73 (24" NW) INV= 686.53 (24" SE)
5 EX STM C.B. RIM= 691.07 INV= 688.97 (24" SW) INV= 688.91 (24" S)	6 EX STM M.H. RIM= 691.33 INV= 687.03 (24" E) INV= 686.83 (24" NW)
7 EX STM INLET RIM= 691.26 INV= 688.40 (8" NW)	8 EX STM M.H. RIM= 691.55 INV= 688.50 (8" SE) INV= 688.30 (8" NW)
9 EX STM M.H. RIM= 691.34 INV= 688.54 (8" NE)	10 EX STM M.H. RIM= 691.53 INV= 688.51 (8" NE)
11 EX STM INLET RIM= 690.97 INV= 688.27 (8" E)	12 EX STM M.H. RIM= 691.48 INV= 688.03 (8" W,SE)
13 EX STM INLET RIM= 692.87 INV= 689.97 (8" N)	14 EX STM C.B. RIM= 693.24 INV= 690.04 (8" SE) INV= 689.84 (8" NW)
15 EX STM INLET RIM= 693.28 INV= 690.48 (8" NE)	16 EX STM C.B. RIM= 693.50 INV= 690.40 (8" SW) INV= 690.20 (8" NE)
17 EX STM INLET RIM= 693.30 INV= 691.05 (8" S)	18 EX STM M.H. RIM= 693.68 WATER FILLED T/WATER= 690.03
19 EX STM M.H. RIM= 693.70	20 EX STM INLET RIM= 693.44 END OF PIPE SEALED
21 EX STM C.B. RIM= 691.68 UNABLE TO OPEN INV= 688.88 (8" SE)	22 EX STM C.B. RIM= 691.50 UNABLE TO OPEN INV= 688.85 (8" S)
23 EX STM C.B. RIM= 691.52 WATER FILLED T/WATER= 687.67	

DEMOLITION LEGEND

- REMOVE EXISTING PAVEMENT/SIDEWALK/STRUCTURE/C&G (INCL SAWCUT)
- REMOVE EXISTING TREE/BUSH/STRUCTURE REMOVAL
- TREE PROTECTION FENCE
- REMOVE EXISTING UTILITY LINE
- REMOVE EXISTING CURB AND GUTTER

DEMOLITION NOTES:

- EROSION CONTROL INSTALLATION SHALL BE DONE PRIOR TO COMMENCEMENT OF ANY DEMOLITION ACTIVITY
- EXISTING ELECTRICAL AND PHONE CABLES MAY BE LOCATED WITHIN THE PROPOSED IMPROVEMENT AREA. APPROXIMATE KNOWN LOCATIONS ARE SHOWN HEREON. THE CONTRACTOR SHALL ARRANGE FOR PRECISE LOCATION OF EXISTING CABLE SERVICES AND EXERCISE EXTREME CARE WHEN WORKING AROUND THE SAME.
- ALL STRUCTURAL PAVEMENT MATERIALS (ASPHALT, CONCRETE SIDEWALK, CURB/GUTTER) THAT CANNOT BE CRUSHED TO AN APPROVED DOT SPECIFICATION FOR USE AS STRUCTURAL FILL SHALL BE DISPOSED OF BY THE CONTRACTOR AT AN OFFSITE LOCATION. RE-USE OF MILLED ASPHALT AND PROPERLY CRUSHED CONCRETE AS STRUCTURAL FILL IS ACCEPTABLE AND ENCOURAGED.
- THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO PREVENT DAMAGE TO EXISTING AMENITIES SCHEDULED TO REMAIN. PROPER SAWCUTTING SHALL BE ACCOMPLISHED AT ALL POINTS OF CONNECTION OR INTERFACE BETWEEN EXISTING AND PROPOSED IMPROVEMENTS.
- CONTRACTOR SHALL BE RESPONSIBLE TO HAVE ALL UNDERGROUND UTILITIES (EVEN IF NOT SHOWN ON THESE PLANS) LOCATED PRIOR TO DEMOLITION WORK. SANITARY SERVICE, WATERMAIN SERVICE, GAS, ELECTRIC, ETC SHALL BE CUT-OFF. CONTRACTOR TO COORDINATE WITH RESPECTIVE MUNICIPAL AGENCY TO ARRANGE FOR DISCONNECT.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE DONE TO EXISTING UTILITIES, STREET LIGHTS, SIGNS, ETC. THAT ARE NOT INTENDED TO BE PERMANENTLY REMOVED.
- CONTRACTOR SHALL NOTIFY THE PUBLIC WORKS DEPARTMENT, ALL UTILITY COMPANIES, AND THE FIRE DEPARTMENT PRIOR TO START UP.
- ON-SITE DISTURBED AREAS TO REMAIN AS GREENSPACE SHALL BE RESTORED WITH MINIMUM 4" TOPSOIL AND SEED, OR RESTORED IN ACCORDANCE WITH THE LANDSCAPE PLAN (SEE BY OTHERS).
- DISTURBED AREAS OF PUBLIC PARKWAYS SHALL BE RESTORED WITH MINIMUM 4" TOPSOIL AND SEED.
- ALL EXISTING DRIVEWAY APRONS SHALL BE SAWCUT ALONG WITH REMOVAL OF ANY EXISTING DEPRESSED CURB AND GUTTER, AND NEW BARRIER CURB AND GUTTER (SIZED TO MEET EXISTING ADJACENT CONDITIONS) SHALL BE INSTALLED AND DOWELED INTO THE EXISTING ADJOINING CURB AND GUTTER.
- UTILITY LINES SCHEDULED FOR REMOVAL SHALL BE PROPERLY DISCONNECTED FROM FACILITIES THAT ARE TO REMAIN, SECURELY PLUGGED AT ALL CONNECTION POINTS, AND EITHER REMOVED OR FILLED WITH FLOWABLE FILL (LEAN CONCRETE MIXTURE) AND ABANDONED IN PLACE (REMOVE IF LOCATED UNDER NEW BUILDING PAD AREAS). IN THE CASE OF STRUCTURE ABANDONMENT, CASTINGS AND TOP SLABS AND CONE SECTIONS SHALL BE REMOVED PRIOR TO FILLING THE STRUCTURE (UNLESS THE STRUCTURE IS EASIER TO COMPLETELY REMOVE).

WATERMAIN STRUCTURES

1 EX VALVE VAULT RIM= 692.67 T/P= 688.02	2 EX WATER M.H. RIM= 691.18 WATER FILLED T/WATER= 689.18
3 EX VALVE VAULT RIM= 693.91	4 EX CLEANOUT RIM= 693.53 T/P= 688.38
5 EX CLEANOUT RIM= 693.55 T/P= 688.35	

SIGWALT 16
ARLINGTON HEIGHTS, ILLINOIS
DEMOLITION PLAN

975 E. 22nd St, Suite 400
Wheaton, IL 60189
630.480.7889
www.rwg-engineering.com



PROJECT NO. 42905219
DATE 04/12/19
SCALE 1"=20'
PROJ. MGR. RWG
PROJ. ASSOC. MRM
DRAWN BY TLM

SHEET

3 OF 10

DATE: 05/07/19, 05/17/19, 06/06/19

REVISIONS:

1.	05/07/19	IN OFFICE/CLIENT REVIEW	TLM
2.	05/17/19	VILLAGE REVIEW #1	TLM
3.	06/06/19	VILLAGE REVIEW #2	ZRN

DRAWN BY: TLM

SITE DATA:

EXISTING ZONING:
VC-PD (VILLAGE CENTER - PLANNED DEVELOPMENT)
TOTAL PROPERTY SIZE BEFORE DEDICATED ROW= 41,939 S.F. (0.963 AC)
TOTAL PROPERTY SIZE AFTER DEDICATED ROW= 39,539 S.F. (0.908 AC)

PROPOSED SITE CONDITIONS:


IMPERVIOUS:
PROPOSED BUILDING IMPERVIOUS FOOTPRINT = 14,356 S.F.
SIDEWALK/CURB/PAVED AREAS = 7,000 S.F.
TOTAL IMPERVIOUS AREA = 21,356 S.F. (54%)

PERVIOUS:
PERMEABLE PAVEMENT AREA = 5,920 S.F.
PROPOSED GREENSPACE = 12,263 S.F.
TOTAL PERVIOUS AREA = 18,183 S.F. (46%)

PROPOSED PARKING SUMMARY: (ONSITE AND ADJACENT ROW)

REGULAR STALLS (ON-SITE) = 8
REGULAR STALLS (ADJACENT ROW) = 3
TOTAL STALLS PROVIDED = 11

- SITE GEOMETRIC AND PAVING NOTES:**
- SIDEWALK RAMPS WITH DETECTABLE WARNINGS AND DEPRESSED CURBS SHALL BE INSTALLED AT ALL SIDEWALK CROSSINGS. SEE CONSTRUCTION STANDARDS FOR SPECIFIC DETAILS.
 - UNLESS OTHERWISE NOTED ON THE PLAN, ALL DIMENSIONS ARE TO THE BACK OF CURB, FACE OF CURB, FACE OF BUILDING, OR PROPERTY LINES.
 - UNLESS OTHERWISE NOTED, ALL CURB AND GUTTER SHALL BE B6.12 CONCRETE CURB AND GUTTER.
 - UNLESS OTHERWISE NOTED, ALL CURB RADI ARE 4' TO BACK OF CURB.
 - ALL BOUNDARY AND LOT DIMENSIONS ARE SHOWN PER THE SUBDIVISION (OR SITE) PLAT PREPARED BY THOMSON SURVEYING LTD. AND DATED 03/11/19.
 - BUILDING DIMENSIONS HAVE BEEN INDICATED HEREON BASED UPON ARCHITECTURAL INFORMATION CURRENT AS OF THE BASE DATE OF THIS PLAN PREPARATION. CONTRACTOR SHALL REFER TO ARCHITECTURAL PLANS FOR PRECISE BUILDING DIMENSIONS AND ADVISE THE ARCHITECT AND ENGINEER OF ANY DISCREPANCIES PRIOR TO CONSTRUCTION.
 - IMPROVEMENTS ADJACENT TO BUILDINGS, IF SHOWN (SUCH AS TRUCK DOCKS, RETAINING WALLS, SIDEWALKS, CURBING, FENCING, CANOPIES, RAMPS, HANDICAP ACCESS, PLANTERS, DUMPSTERS, TRANSFORMERS, BOLLARDS, ETC) HAVE BEEN SHOWN FOR APPROXIMATE LOCATION ONLY. REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATIONS, SPECIFICATIONS AND DETAILS.
 - THE LOCATION OF PRIVATE SIDEWALKS SHALL BE COORDINATED WITH PROPOSED DRIVEWAYS. CONTRACTOR TO VERIFY ACTUAL DRIVEWAY LOCATION WITH ARCHITECTURAL PLANS PRIOR TO CONSTRUCTING SIDEWALKS.
 - UPON COMPLETION OF PAVING OPERATIONS, THE CONTRACTOR SHALL INSTALL THE PAVEMENT MARKINGS AND STRIPES AND ALL DIRECTIONAL SIGNAGE, ETC AS SHOWN HEREON AND ON SIGNAGE AND STRIPING PLAN. PARKING STALL (EXCEPT FOR HC) MARKING COLOR IS WHITE. ALL ONSITE PAVEMENT MARKINGS AND STRIPES SHALL BE PAINTED WITH HDOT SPECIFICATION PAVEMENT PAINT. PARKING STALL STRIPES SHALL BE 4" WIDE. HANDICAP STALLS SHALL BE PAINTED YELLOW AND SIGNED PER FEDERAL, STATE AND LOCAL REQUIREMENTS.
 - PRIOR TO INSTALLING ALL TRAFFIC CONTROL SIGNAGE SHALL BE INSTALLED AS INDICATED. SIGNS SHALL BE INSTALL WITH 3" SQUARE ALUMINUM POSTS WITH A BAKED ON ENAMEL FINISH, SET 1" INTO CONCRETE PIER AND SHALL INCLUDE A POST CAP.
 - ALL ROADWAY PATCHES SHALL HAVE SURFACE ASPHALT LAYER EXTEND 2.0' BEYOND EDGE OF TRENCH.
 - ANY STAIRWAYS LEADING TO PUBLIC SIDEWALK SHALL NOT AFFECT THE ADA COMPLIANCE OF THE PUBLIC WALK.



SURFACE IMPROVEMENT LEGEND:


- PERMEABLE PAVERS SEE DETAIL
- VILLAGE STANDARD BRICK PAVEMENT SEE DETAIL
- CONCRETE DRIVEWAY ENTRANCE & APRONS (GARAGE ENTRY) 6" PCC PAVEMENT WITH 6"x6" No. 6 WELDED WIRE MESH (NO WELDED WIRE MESH IN PUBLIC RIGHT-OF-WAY) 6" AGGREGATE BASE COURSE CA-6, TYPE B
- CONCRETE SIDEWALKS (PUBLIC AND/OR PRIVATE) 4" PCC SIDEWALK 4" AGGREGATE BASE COURSE TYPE B, CA-6
- EX CURB AND GUTTER
- CURB AND GUTTER (B6.12) SEE DETAIL SHEET
- REVERSED PITCH CURB AND GUTTER
- DEPRESSED CURB AND GUTTER
- ADA CURB RAMP WITH DETECTABLE WARNING

ABBREVIATIONS LEGEND (IN ADDITION TO TITLE SHEET LEGEND)

- EX = EXISTING
- PR = PROPOSED
- BC = BACK OF CURB
- FC = FACE OF CURB
- ED = EDGE OF PAVEMENT
- PL = PROPERTY LINE
- FB = FACE OF BUILDING
- FW = FACE OF WALK (SIDEWALK)
- ROW = RIGHT OF WAY
- BC/BC = BACK OF CURB TO BACK OF CURB
- SW = SIDEWALK
- R = RADIUS
- RW = RETAINING WALL (TYP) = TYPICAL




TECHNICAL GUIDANCE MANUAL TYPICAL SIGNAGE FOR PERMEABLE PAVEMENT AREA

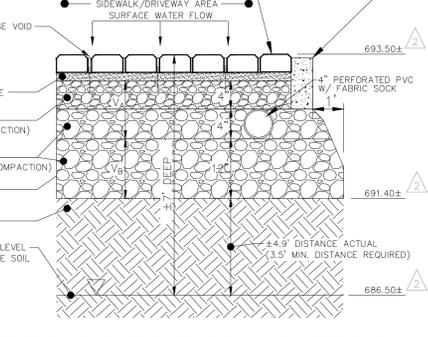

PERMEABLE PAVEMENT SECTION

- NOTES:**
- OFFSET A MINIMUM OF 10 FEET FROM FOUNDATIONS UNLESS WATERPROOFED, 20 FEET FROM SANITARY SEWERS, 20 FEET FROM ROADWAY SHOULDER AND 100 FEET FROM POTABLE WATER WELLS OR SEPTIC TANKS.
 - AVOID INSTALLATION ON SLOPES GREATER THAN 15 TO 1 AND ABOVE COMPACTED FILL.
 - WOVEN GEOTEXTILE FABRIC SHALL MEET REQUIREMENTS OF IUM MATERIAL SPECIFICATION 592 GEOTEXTILE, TABLE 1, CLASS 1, WITH AN APPARENT OPENING SIZE OF 0.50 MM.
 - STONE STORAGE OPTIONS ARE CA-7, DISTRICT VULCAN MIX, OR APPROVED ALTERNATE. NO RECYCLED MATERIALS.
 - MINIMUM DISTANCE OF 2 FEET (1.5 FEET IN COMBINED SEWER AREAS) BETWEEN BOTTOM OF BMP AND SEASONALLY HIGH GROUNDWATER LEVEL.
 - UNDERDRAINS ARE REQUIRED IN TYPICAL CLAYEY SOILS WHERE INFILTRATION RATES ARE LESS THAN 0.5 INCH/HR. MAXIMUM OF 1 UNDERDRAIN PER 30 FEET. PROVIDE A SOIL REPORT DOCUMENTING NATIVE INFILTRATION RATE TO FOREGO UNDERDRAINS.
 - MINIMUM UNDERDRAIN BEDDING OF TWO INCHES, MAXIMUM OF 12 INCHES.
 - ONE OBSERVATION WELL REQUIRED PER 40,000 SQUARE FEET OF SURFACE AREA.
 - FOLLOW THE REQUIRED PRETREATMENT MEASURES LISTED ON THE VOLUME CONTROL PRETREATMENT MEASURES DETAIL.
 - MAINTENANCE REQUIREMENTS INCLUDE ANNUAL VACUUMING AND LOW-PRESSURE POWER WASHING OF PAVEMENT SURFACE. ADJACENT VEGETATED AREAS SHALL BE WELL MAINTAINED. BARE SPOTS AND ERODED AREAS SHALL BE REPLANTED AND STABILIZED IMMEDIATELY. DO NOT SEALCOAT.
 - APPROPRIATE SIGNAGE REQUIRED FOR FACILITY. REFER TO THE SIGNAGE FOR PERMEABLE PAVEMENT DETAIL.

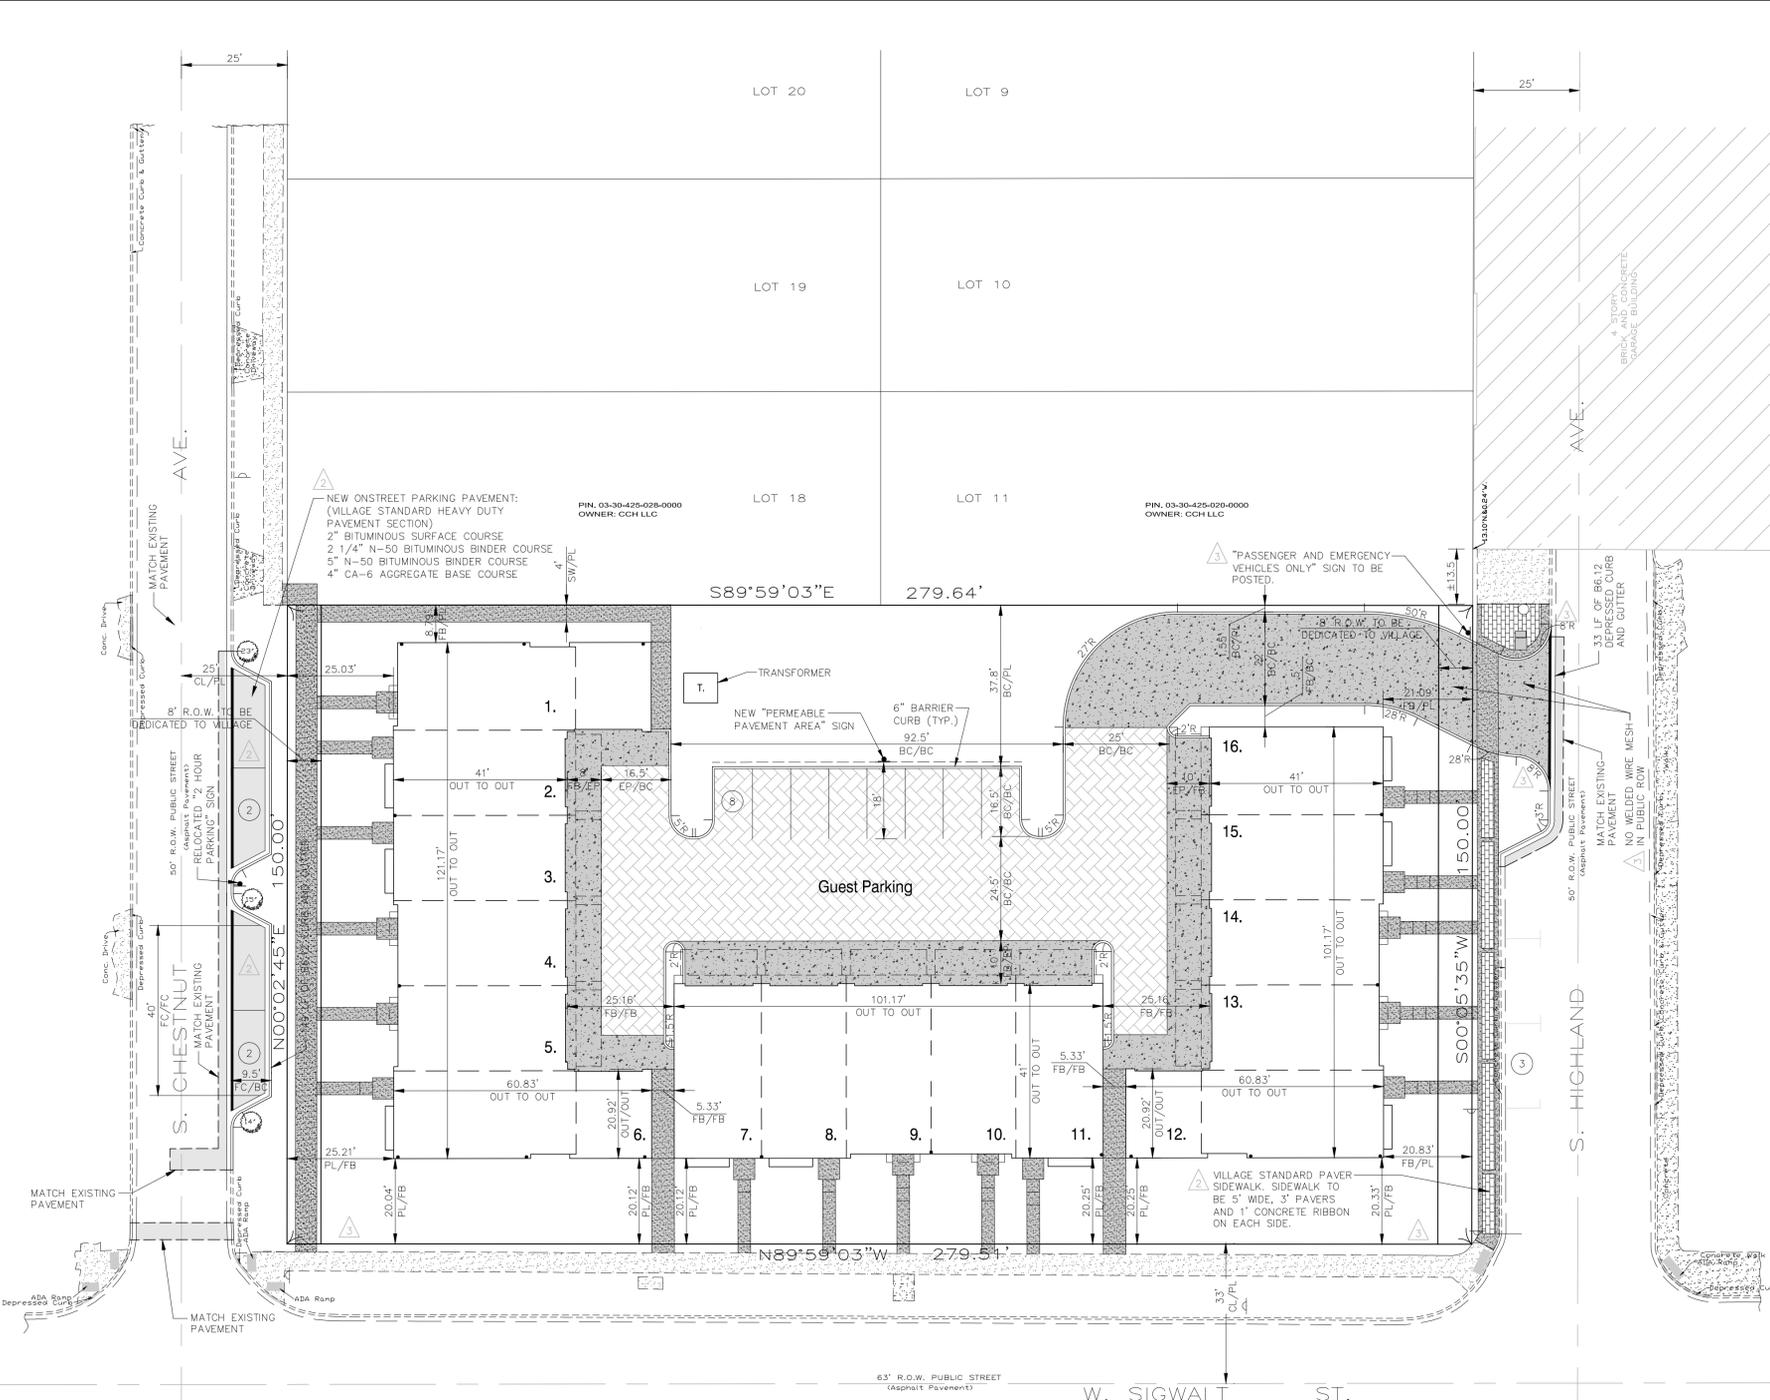

VILLAGE OF ARLINGTON HEIGHTS SIDEWALK REQUIREMENTS


REINFORCEMENT:
No welded steel fabric is allowed to be placed in any sidewalk in the Village right-of-way or any sidewalk to be maintained by the Village. Where sidewalks cross over a utility conduit, use an reinforcing steel that is placed mid-depth within sidewalk and extend to a minimum of 5 feet beyond each side of the utility conduit.

FORMS:
Side forms shall be further with a nominal thickness of 2 inches and a depth equal to the sidewalk thickness specified or steel with equal rigidity. 2x4 forms will not be allowed. Side forms shall be kept securely in place by stakes or bracing, while the top edge of the forms face to grade. The forms shall be tightly coated with oil prior to placing concrete.


FORM REMOVAL AND BACKFILL:
Unless otherwise approved by the Director of Engineering, all forms shall remain undisturbed for a minimum of 24 hours after the concrete has been placed, and be removed within 48 hours. Upon the removal of the forms, the Contractor shall have seven consecutive days to backfill between the side of the sidewalk and all structures, such as light enclosures, manholes, etc. which extend through the sidewalk until soil has been placed.

EXPANSION JOINTS:
Expansion joints shall consist of preformed joint filler, 1/2 inch thick. The top of the expansion joint shall be placed 1/4 inch below the surface of the sidewalk, and extend to the full depth of the walk. Expansion joints shall be spaced a minimum of 50 feet and shall also be placed between the sidewalk and all structures, such as light enclosures, manholes, etc. which extend through the sidewalk.


PLACING, FINISHING, PROTECTION AND CURING:
The concrete sidewalk shall be placed and finished in accordance with Article 424.08 of the Standard Specifications for Road and Bridge Construction.
All exposed concrete surfaces shall be protected against damage by rain or other natural causes. The Contractor shall be responsible for protecting the concrete against vandalism until the concrete is set and cured.
The concrete shall be cured for a minimum period of three days after placement as described in Article 725.13 of the Standard Specifications for Road and Bridge Construction.

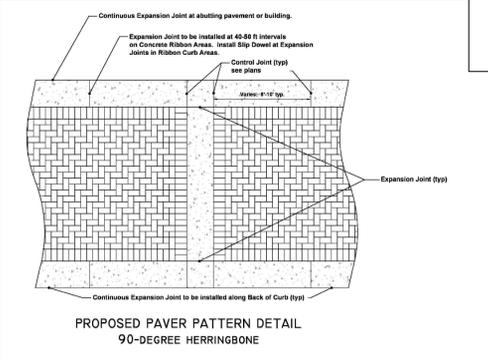

VILLAGE PAVEMENT DETAILS

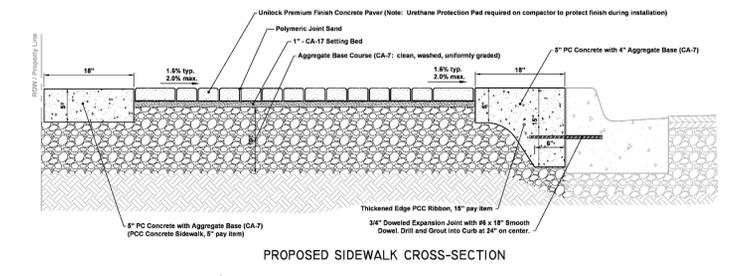

PROPOSED SIDEWALK CROSS-SECTION

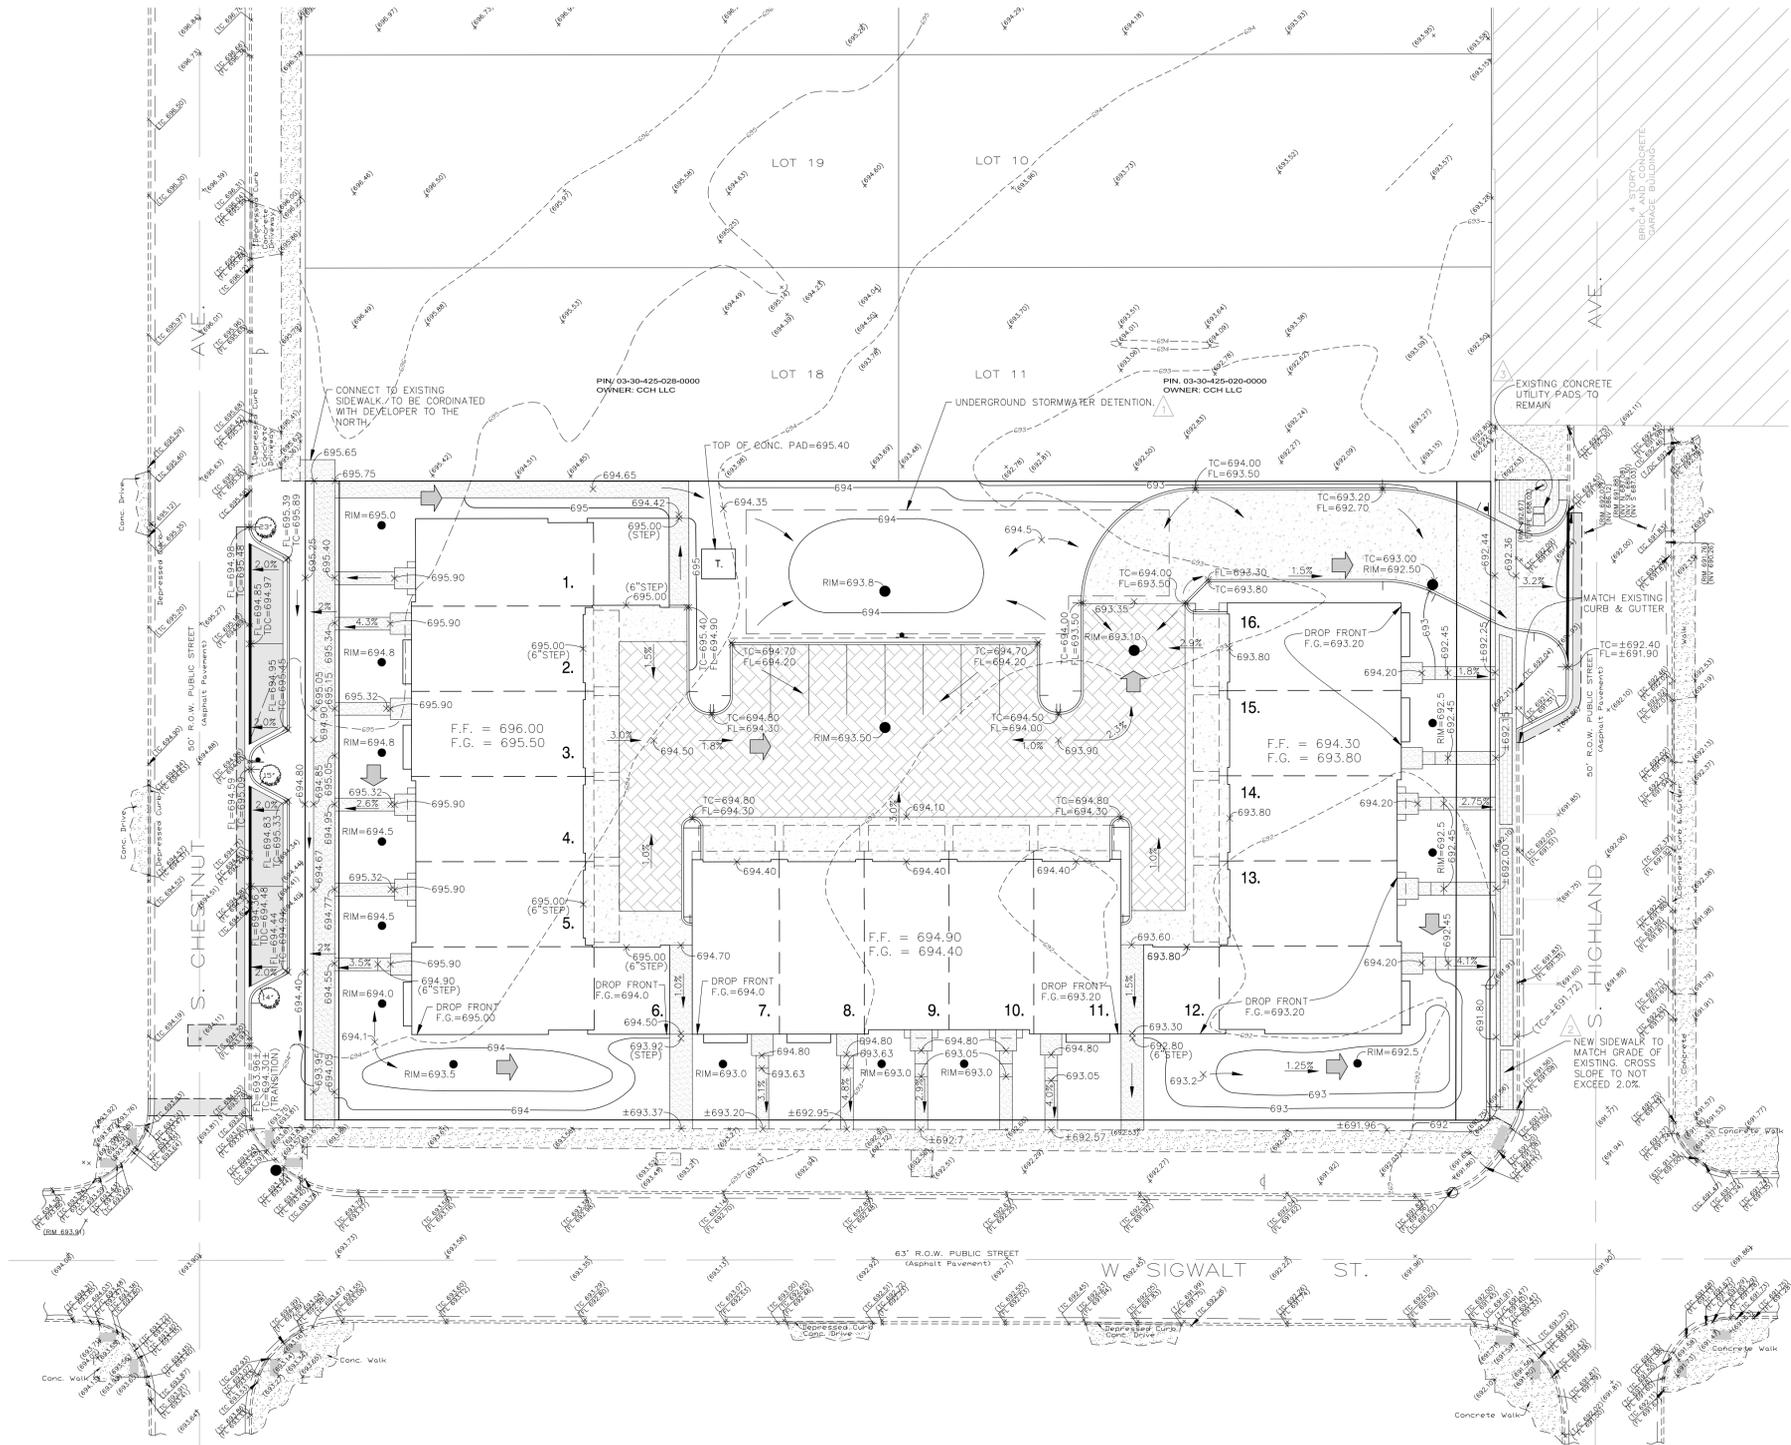

GRADING LEGEND

	EXISTING	PROPOSED
CONCRETE HEADWALL		
PRECAST FLARED END SECTION		
STORM DRAINAGE STRUCTURE		
RETAINING WALL		
CONTOUR		
5' CONTOUR		
SPOT ELEVATION		
DIRECTION OF SURFACE FLOW		
DITCH OR SWALE		
OVERFLOW RELIEF ROUTING		
SLOPE BANK		
RR-3 ROCK RIP-RAP		

- GRADING NOTES:**
1. PAVEMENT SLOPES WITHIN HANDICAP ACCESSIBLE PARKING AREAS SHALL NOT EXCEED 2.00% IN ANY DIRECTION.
 2. HANDICAP RAMPS SHALL BE CONSTRUCTED WITH A CROSS SLOPE NOT TO EXCEED 2.00%.
 3. UNLESS SPECIFICALLY INDICATED OTHERWISE, EXISTING GRADES ARE TO BE MET AT PROJECT PERIMETER LINES.
 4. THE CONTRACTOR SHALL REFER TO THE SOIL EROSION AND SEDIMENT CONTROL PLANS AND DETAILS (AND SWPPP DOCUMENTS IF APPLICABLE) FOR THE INSTALLATION OF EROSION CONTROL MEASURES PRIOR TO BEGINNING GRADING OPERATIONS.
 5. UNLESS OTHERWISE NOTED, SPOT ELEVATIONS AND PROPOSED CONTOURS REFLECT THE FINISHED PAVEMENT SURFACE GRADE, TOP OF CURB GRADE, OR FINISHED GROUND ELEVATION AS APPLICABLE.
 6. RIM GRADES FOR DRAINAGE STRUCTURES REFLECT THE FLOW LINE ELEVATION OF THE GUTTER, PAVEMENT OR DRAINAGE SWALE (AS APPLICABLE).
 7. WHEREVER THE DESIGN FOR SURFACE FLOW OF DRAINAGE IS DIRECTED AWAY FROM A CURB, THE CONTRACTOR SHALL INSTALL REVERSE GUTTER PITCH.
 8. ALL STEPS 7" UNLESS CALLED OUT OTHERWISE.

REVISIONS

DATE	IN	OFFICE/CLIENT REVIEW	BY
05/07/19	1.	TLM	TLM
05/17/19	2.	VILLAGE REVIEW #1	ZRN
05/06/19	3.	VILLAGE REVIEW #2	ZRN

DRAWN BY: TLM


SIGWALT 16
ARLINGTON HEIGHTS, ILLINOIS
GRADING PLAN

975 E. 22nd St, Suite 400
 Wheaton, IL 60189
 630.480.7889
 www.rwg-engineering.com



PROJECT NO. 42905219
 DATE 04/12/19
 SCALE 1"=20'
 PROJ. MGR. RWG
 PROJ. ASSOC. MRM
 DRAWN BY TLM

SHEET
6 OF 10



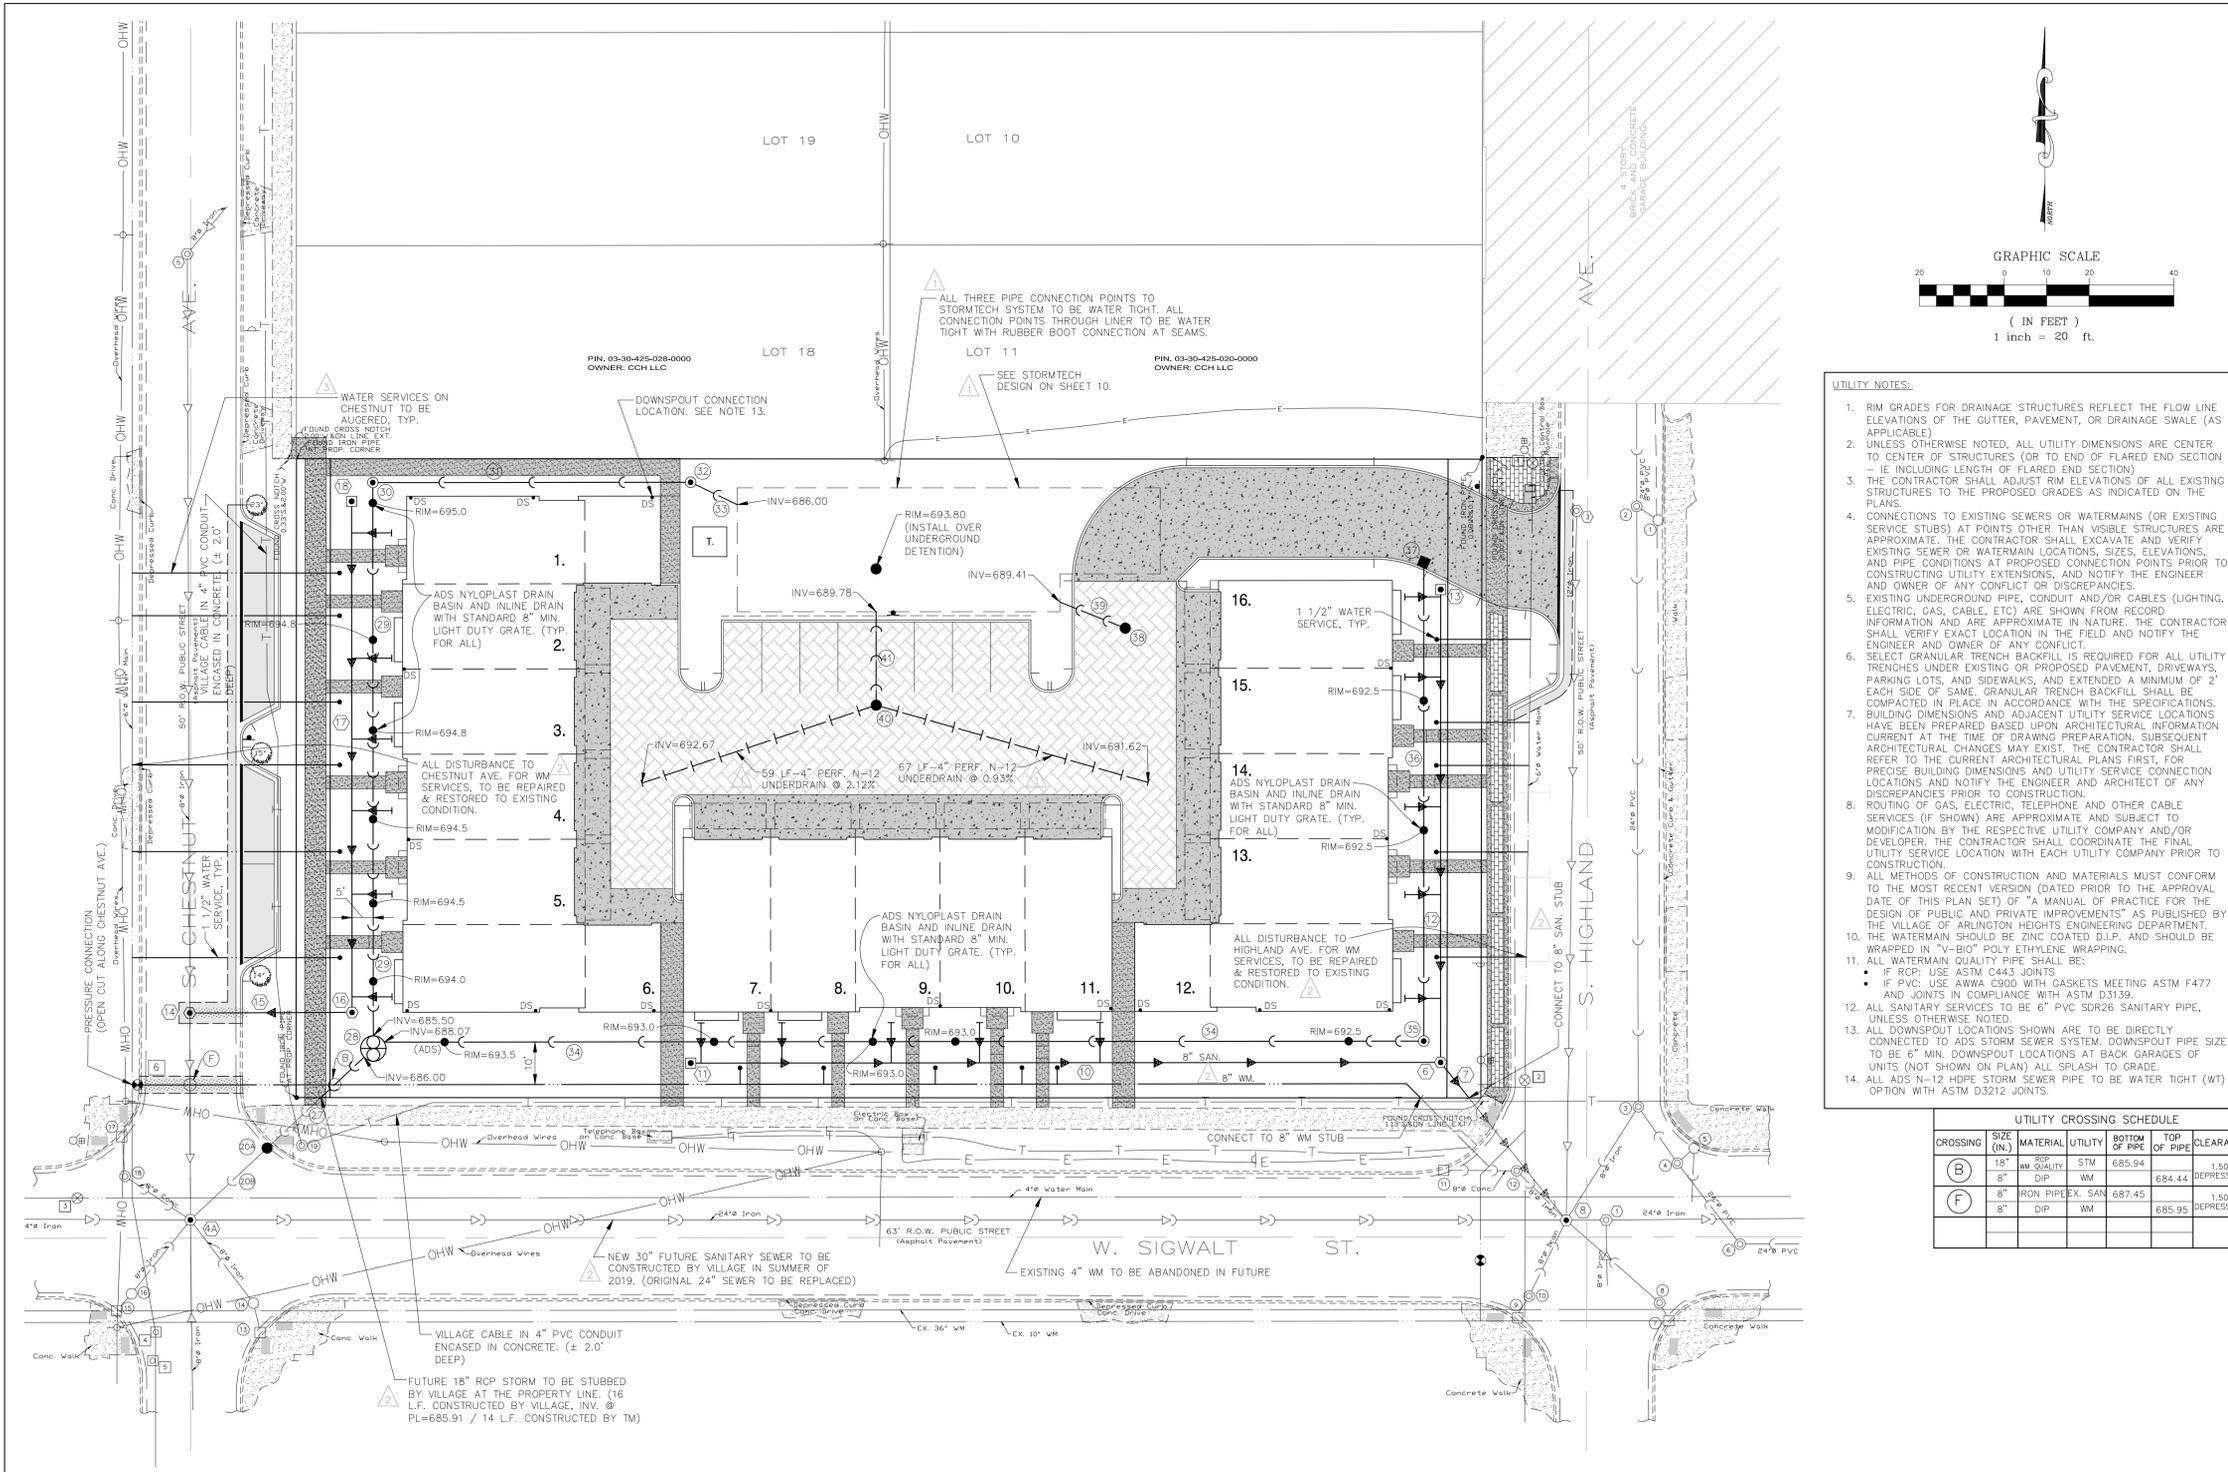


- UTILITY NOTES:**
- RIM GRADES FOR DRAINAGE STRUCTURES REFLECT THE FLOW LINE ELEVATIONS OF THE GUTTER, PAVEMENT, OR DRAINAGE SWALE (AS APPLICABLE).
 - UNLESS OTHERWISE NOTED, ALL UTILITY DIMENSIONS ARE CENTER TO CENTER OF STRUCTURES (OR TO END OF FLARED END SECTION - IE INCLUDING LENGTH OF FLARED END SECTION).
 - THE CONTRACTOR SHALL ADJUST RIM ELEVATIONS OF ALL EXISTING STRUCTURES TO THE PROPOSED GRADES AS INDICATED ON THE PLANS.
 - CONNECTIONS TO EXISTING SEWERS OR WATERMANS (OR EXISTING SERVICE STUBS) AT POINTS OTHER THAN VISIBLE STRUCTURES ARE APPROXIMATE. THE CONTRACTOR SHALL EXCAVATE AND VERIFY EXISTING SEWER OR WATERMAN LOCATIONS, SIZES, ELEVATIONS, AND PIPE CONDITIONS AT PROPOSED CONNECTION POINTS PRIOR TO CONSTRUCTING UTILITY EXTENSIONS, AND NOTIFY THE ENGINEER AND OWNER OF ANY CONFLICT OR DISCREPANCIES.
 - EXISTING UNDERGROUND PIPE, CONDUIT AND/OR CABLES (LIGHTING, ELECTRIC, GAS, CABLE, ETC) ARE SHOWN FROM RECORD INFORMATION AND ARE APPROXIMATE IN NATURE. THE CONTRACTOR SHALL VERIFY EXACT LOCATION IN THE FIELD AND NOTIFY THE ENGINEER AND OWNER OF ANY CONFLICT.
 - SELECT GRANULAR TRENCH BACKFILL IS REQUIRED FOR ALL UTILITY TRENCHES UNDER EXISTING OR PROPOSED PAVEMENT, DRIVEWAYS, PARKING LOTS, AND SIDEWALKS, AND EXTENDED A MINIMUM OF 2' EACH SIDE OF SAME. GRANULAR TRENCH BACKFILL SHALL BE COMPACTED IN PLACE IN ACCORDANCE WITH THE SPECIFICATIONS.
 - BUILDING DIMENSIONS AND ADJACENT UTILITY SERVICE LOCATIONS HAVE BEEN PREPARED BASED UPON ARCHITECTURAL INFORMATION CURRENT AT THE TIME OF DRAWING PREPARATION. SUBSEQUENT ARCHITECTURAL CHANGES MAY EXIST. THE CONTRACTOR SHALL REFER TO THE CURRENT ARCHITECTURAL PLANS FIRST, FOR PRECISE BUILDING DIMENSIONS AND UTILITY SERVICE CONNECTION LOCATIONS AND NOTIFY THE ENGINEER AND ARCHITECT OF ANY DISCREPANCIES PRIOR TO CONSTRUCTION.
 - ROUTING OF GAS, ELECTRIC, TELEPHONE AND OTHER CABLE SERVICES (IF SHOWN) ARE APPROXIMATE AND SUBJECT TO MODIFICATION BY THE RESPECTIVE UTILITY COMPANY AND/OR DEVELOPER. THE CONTRACTOR SHALL COORDINATE THE FINAL UTILITY SERVICE LOCATION WITH EACH UTILITY COMPANY PRIOR TO CONSTRUCTION.
 - ALL METHODS OF CONSTRUCTION AND MATERIALS MUST CONFORM TO THE MOST RECENT VERSION (DATED PRIOR TO THE APPROVAL DATE OF THIS PLAN SET) OF "A MANUAL OF PRACTICE FOR THE DESIGN OF PUBLIC AND PRIVATE IMPROVEMENTS" AS PUBLISHED BY THE VILLAGE OF ARLINGTON HEIGHTS ENGINEERING DEPARTMENT.
 - THE WATERMAIN SHOULD BE ZINC COATED D.I.P. AND SHOULD BE WRAPPED IN "V-BIO" POLY ETHYLENE WRAPPING.
 - ALL WATERMAIN QUALITY PIPE SHALL BE:
 - IF RCP: USE ASTM C443 JOINTS
 - IF PVC: USE AWWA C900 WITH GASKETS MEETING ASTM F477 AND JOINTS IN COMPLIANCE WITH ASTM D3139.
 - ALL SANITARY SERVICES TO BE 6" PVC SDR26 SANITARY PIPE, UNLESS OTHERWISE NOTED.
 - ALL DOWNSPOUT LOCATIONS SHOWN ARE TO BE DIRECTLY CONNECTED TO ADS STORM SEWER SYSTEM. DOWNSPOUT PIPE SIZE TO BE 6" MIN. DOWNSPOUT LOCATIONS AT BACK GARAGES OF UNITS (NOT SHOWN ON PLAN) ALL SPLASH TO GRADE.
 - ALL ADS N-12 HDPE STORM SEWER PIPE TO BE WATER TIGHT (WT) OPTION WITH ASTM D3212 JOINTS.

UTILITY CROSSING SCHEDULE

CROSSING	SIZE (IN.)	MATERIAL	UTILITY	BOTTOM OF PIPE	TOP OF PIPE	CLEARANCE
(B)	18"	WM	BACKLIT STM	685.94	684.44	1.50' DEPRESS WM
(F)	8"	DIP	WM	687.45	685.95	1.50' DEPRESS WM

UTILITY STRUCTURE SCHEDULE		
SANITARY SEWER STRUCTURES		
1 EX SAN M.H. RIM= 691.91 INV= 684.56 (8" S) INV= 684.26 (24" W) INV= 684.21 (24" E)	2 EX SAN M.H. RIM= 691.94 INV= 686.99 (8" NE) INV= 687.04 (8" SE) INV= 688.49 (8" SW) INV= 686.84 (8" NW) INV= 684.39 (24" W) INV= 684.29 (24" E)	3 EX SAN M.H. RIM= 692.02 INV= 686.12 (12" S)
4 EX SAN M.H. (OLD) RIM= 693.95 INV= 689.85 (8" SE) INV= 685.75 (8" S) INV= 689.53 (8" SW) INV= 689.50 (8" NW) INV= 687.25 (8" N) INV= 690.00 (8" NE) INV= 685.40 (24" E)	4A FUTURE SAN M.H. 30" DIA. TYPE A RIM= 694.14 INV= 689.00 (E,W) *21" INV= 685.67 (NE) 14" INV= 688.90 (N) 14" INV= 689.70 (SW) 14" INV= 688.90 (SE)	5 EX SAN M.H. RIM= 695.21 INV= 690.76 (8" NE) INV= 688.73 (8" S)
6 SAN M.H. 48" DIA. TYP. A RIM= 693.00 INV= 687.30 (N) INV= 686.15 (SE,W)	7 10 LF - 8" PVC, WM QUALITY SAN @ 0.45%	8 FUTURE SAN M.H. RIM= 692.11 PROP. INV= 685.93 (NW)
9 SAN M.H. 60" DIA. TYP. A RIM= 695.75 INV= 685.29 (24" E)	10 176 LF - 8" PVC, WM QUALITY SAN @ 0.45%	11 SANITARY CLEANOUT RIM= 693.50 INV= 686.95
12 112 LF - 8" PVC, WM QUALITY SAN @ 0.45%	13 SANITARY CLEANOUT RIM= 692.80 INV= 687.80	14 SAN M.H. 48" DIA. TYP. A RIM= 694.10 INV= 688.50 EX INV= 687.58
15 38 LF - 8" PVC, WM QUALITY SAN @ 1.32%	16 SAN INSPECTION M.H. 48" DIA. TYP. A RIM= 694.10 INV= 689.00	17 120 LF - 8" PVC, WM QUALITY SAN @ 1.25%
18 SAN M.H. 48" DIA. TYP. A RIM= 694.10 INV= 688.50 EX INV= 687.58	19 SAN M.H. 48" DIA. TYP. A RIM= 694.10 INV= 688.50 EX INV= 687.58	20 SAN M.H. 48" DIA. TYP. A RIM= 694.10 INV= 688.50 EX INV= 687.58
STORM SEWER STRUCTURES		
1 EX STM C.B. RIM= 691.76 INV= 690.26 (8" NW)	2 EX STM M.H. RIM= 691.88 INV= 687.08 (24" N) INV= 689.30 (8" E) INV= 687.03 (24" S)	3 EX STM M.H. RIM= 691.49 INV= 686.67 (24" SE) INV= 686.09 (8" SW) INV= 686.59 (24" N)
4 EX STM M.H. RIM= 691.33 INV= 686.73 (24" NW) INV= 686.53 (24" SE)	5 EX STM C.B. RIM= 691.07 INV= 688.97 (24" S)	6 EX STM M.H. RIM= 691.83 INV= 687.03 (24" E) INV= 688.91 (24" NW)
7 EX STM INLET RIM= 691.26 INV= 688.40 (8" NW)	8 EX STM M.H. RIM= 691.55 INV= 688.50 (8" SE) INV= 688.30 (8" NW)	9 EX STM INLET RIM= 691.44 INV= 688.54 (8" NE)
10 EX STM M.H. RIM= 691.53 INV= 688.51 (8" NE)	11 EX STM INLET RIM= 690.97 INV= 688.27 (8" E)	12 EX STM M.H. (OPEN LID) RIM= 691.48 INV= 688.03 (8" W,SE,N)
13 EX STM INLET RIM= 692.87 INV= 689.97 (8" N)	14 EX STM C.B. RIM= 693.24 INV= 690.04 (8" SE) INV= 689.94 (8" NW)	15 EX STM INLET RIM= 693.28 INV= 690.48 (8" NE)
16 EX STM C.B. RIM= 693.50 INV= 690.40 (8" SW) INV= 690.20 (8" NE)	17 EX STM INLET RIM= 691.05 INV= 691.05 (8" S)	18 EX STM M.H. RIM= 693.68 WATER FILLED T/WATER= 690.03
19 EX STM M.H. RIM= 693.70	20 EX STM INLET (OLD) RIM= 691.44 UNABLE TO OPEN END OF PIPE SEALED	21 EX STM C.B. RIM= 691.68 WATER FILLED T/WATER= 690.03
22 EX STM C.B. RIM= 691.50 UNABLE TO OPEN INV= 688.85 (8" S)	23 EX STM C.B. RIM= 691.52 WATER FILLED T/WATER= 687.67	24 30 LF - 18" RCP STORM SEWER @ 0.67% W/ ASTM C443 JOINTS. (PORTION STUBBED BY VILLAGE)
25 SPECIAL RESTRICTOR STRUCTURE, SEE DETAIL 72" DIA. TYP. C RIM= 694.00 INV= 685.50 (N) INV= 688.07 (E) INV= 686.00 (S) *SEE CHECK VALVE DETAIL, INSTALLED ON DOWNSTREAM PIPE	26 130 LF - 18" ADS N-12 HDPE STM @ 0.23%	27 STM M.H. 48" DIA. TYPE C RIM= 695.10 INV= 685.80
28 75 LF - 18" ADS N-12 HDPE STM @ 0.23%	29 245 LF - 12" ADS N-12 HDPE STM @ 0.40%	30 STM M.H. 48" DIA. TYPE C RIM= 694.40 INV= 685.97
29 113 LF - 12" ADS N-12 HDPE STM @ 0.40%	30 STM M.H. 48" DIA. TYPE C RIM= 693.50 INV= 689.05	31 STM M.H. 48" DIA. TYPE C RIM= 693.10 INV= 689.60
30 19 LF - 12" ADS N-12 HDPE STM @ 1.00%	31 STM C.B. 48" DIA. TYPE C RIM= 693.10 INV= 689.60	32 STM M.H. 48" DIA. TYPE C RIM= 694.40 INV= 685.97
31 FUTURE STM C.B. 48" DIA. TYPE C RIM= 693.61 INV= 685.80 (18" NE) INV= 685.80 (21" SW)	32 FUTURE 25 LF - 21" RCP STORM SEWER W/ RUBBER GASKET @ 0.50%	33 STM C.B. 48" DIA. TYPE C RIM= 693.50 INV= 691.42 (4" PVC SE) INV= 691.42 (4" PVC SW) INV= 690.00 (12" N)
32 EX VALVE VAULT RIM= 692.67 T/P= 688.02	34 EX VALVE VAULT RIM= 693.91	34 EX VALVE VAULT RIM= 693.91
33 EX CLEANOUT RIM= 693.53 T/P= 688.38	35 EX CLEANOUT RIM= 693.55 T/P= 688.35	35 8" VALVE IN 60" VAULT PRESSURE CONNECTION TO EXISTING 6" WM. RIM= 693.75
34 8" VALVE IN 60" VAULT PRESSURE CONNECTION TO EXISTING 6" WM. RIM= 692.00	35 6" DUCTILE IRON WM. CL. WITH 6" SERVICE VALVE @ 0.50% (DOMESTIC SUPPLY LINE) RIM= 693.80	36 STM C.B. 48" DIA. TYPE C RIM= 693.10 INV= 689.60
STORM SEWER DRAINAGE STRUCTURE LEGEND		
EXISTING	PROPOSED	2 SANITARY STRUCTURE NUMBER
○	●	1) STORM STRUCTURE NUMBER
○	●	5 WATERMAIN STRUCTURE NUMBER
○	●	
○	●	

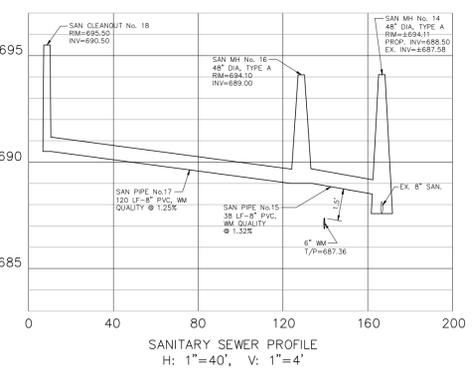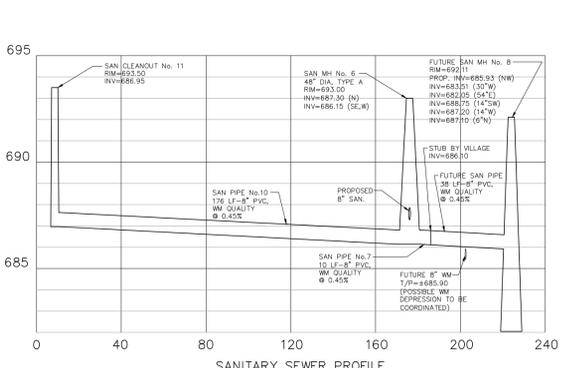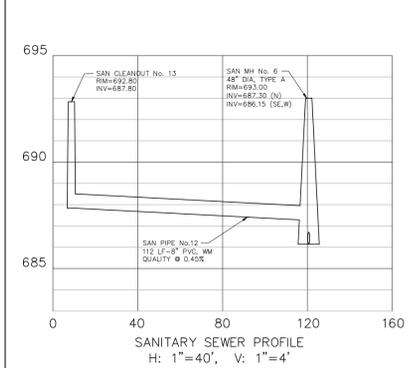

DRAWN BY: TLM

REVISIONS:

DATE	IN	OFFICE/CLIENT REVIEW	TLM
1. 05/07/19	1.		TLM
2. 05/17/19	2.		ZRN
3. 06/06/19	3.		ZRN

PROJECT NO. 42905219

DATE: 04/12/19

SCALE: 1"=20'

PROJ. MGR. RWG

PROJ. ASSOC. MRM

DRAWN BY: TLM

SHEET 7 OF 10

June 05, 2019 12:26:40 p.m. AcadVer:22.0s (LMS Tech)

Drawing: S:\42905219 - SIGWALT TOWNHOMES\300_ENGINEERING\310_CADD\FINAL\429_BASE.DWG

975 E. 22nd St, Suite 400
Wheaton, IL 60189
630.480.7889
www.rwg-engineering.com

RWG Engineering, LLC
Civil Engineering • Real Estate Consulting • Project Management

SIGWALT 16
ARLINGTON HEIGHTS, ILLINOIS
UTILITY PLAN

© COPYRIGHT 2017

CHECKMATE ULTRAFLEX SLIP-IN IN-LINE CHECK VALVES
 Specification TM-CMUF-SL

PART 1: GENERAL

- 1.01 SUBMITTALS
- Submit product literature that includes information on the performance and operation of the valve, materials of construction, dimensions and weights, elastomer characteristics, headloss, flow data and pressure ratings.
 - Upon request, provide shop drawings that clearly identify the valve materials of construction and dimensions.
- 1.02 QUALITY ASSURANCE
- Supplier shall have at least twelve (12) years experience in the design and manufacture of "CheckMate™" style elastomeric check valves.
 - Manufacturer shall have designed, fabricated and have at least five (5) current projects in the construction of "CheckMate" style elastomeric check valves in the 72" (1800mm) size. Manufacturer must provide documentation, including project name, location, and references.
 - Manufacturer shall have conducted independent hydraulic testing to determine headloss, jet velocity and vertical opening height characteristics on a minimum of three (3) sizes of CheckMate Valves ranging from 6" (150mm) through 24" (600mm). The testing must have been conducted for both pressurized and open channel flow (discharging to atmosphere) and submerged conditions.

PART 2: PRODUCTS

2.01 CHECKMATE ULTRAFLEX ELASTOMERIC CHECK VALVES

- Check Valves are to be all rubber and the flow operated check type with slip-in cuff connection. The entire CheckMate Ultraflex Valve shall be pre-fabricated through the valve, saddle and bill, which is cured and vulcanized into a one-piece unitary construction. A separate valve body or pipe used as the housing is not acceptable. The valve shall be manufactured with no metal, mechanical linkages or fasteners, which would be used to secure any component of the valve to a valve housing. The port area of the saddle shall contain in a circumferential groove a circumferential gasket that is concentric with the pipe which shall allow passage of flow in one direction while preventing reverse flow. The entire valve shall fit within the pipe inside diameter. The saddle area of the valve must be flat, not conical, and integral with the rubber body above centerline in order to maintain a consistent seal. The valve shall be free of any trap debris. The valve must be easily installed in pipes with poor end condition without the need to modify or utilize the headwall or structure to seal and anchor the valve. Once installed, the CheckMate Ultraflex Valve shall not protrude beyond the face of the structure or end of the pipe.
- The CheckMate Ultraflex Valve shall incorporate multiple concave grooves molded integrally into the flat saddle wall thickness extending longitudinally a minimum of 80% of the length of the saddle to reduce opening resistance and reduce headloss.
- The CheckMate Ultraflex Valve shall incorporate a custom shaped notch in the end of the bill to reduce cracking pressure. The notch shall be at the invertbottom of the bill and symmetrical about the valve centerline. The longitudinal length of the notch shall be no greater than half the length of the bill.
- The outside diameter of the upstream and downstream sections of the valve must be circumferentially in contact with the inside diameter of the pipe.
- Slip-in style CheckMate Ultraflex Valves will be furnished with a set of stainless steel expansion clamps. The clamps, which will secure the valve in place, shall be installed on the upstream or downstream cuff of the valve, depending on installation orientation, and shall expand outward by means of a turnbuckle. Each band shall be pre-drilled allowing for the valve to be pinned and secured into position in accordance with the manufacturer's installation instructions.
- Manufacturer must have flow test data from an accredited hydraulics laboratory to confirm pressure drop and hydraulic data.
- Company name, plant location, valve size patent number, and serial number shall be bonded to the check valve.

2.02 FUNCTION

- When line pressure exceeds the backpressure, the line pressure forces the bill and saddle of the valve open, allowing flow to pass. When the backpressure exceeds the bill and saddle of the valve is forced closed, preventing backflow.

2.03 MANUFACTURER

- All valves shall be Series CMUF-SL slip-in CheckMate Ultraflex Valves as manufactured by Tidelflex Technologies®, A Division of Red Valve Company, Carnegie, PA 15106. All valves shall be manufactured in the U.S.A.

PART 3: EXECUTION

3.01 INSTALLATION

- Valve shall be installed in accordance with manufacturer's written Installation and Operation Manual and approved submittals.

3.02 MANUFACTURER'S CUSTOMER SERVICE

- Manufacturer's authorized representative shall be available for customer service during installation and start-up, and to train personnel in the operation, maintenance and troubleshooting of the valve.
- If specified, the manufacturer shall also make customer service available directly from the factory in addition to authorized representatives for assistance during installation and start-up, and to train personnel in the operation, maintenance and

THE FOLLOWING MATERIALS ARE ALLOWED ON A QUALIFIED BASIS SUBJECT TO DISTRICT REVIEW AND APPROVAL PRIOR TO PERMIT ISSUANCE. SPECIAL CONDITIONS MAY BE ADDED TO THE PERMIT WHEN THE PIPE MATERIAL BELOW IS USED FOR SEWER CONSTRUCTION OR A CONNECTION IS MADE.

PIPE SPECIFICATIONS	JOINT SPECIFICATIONS
POLYPROPYLENE (PP)	
12-INCH TO 24-INCH DOUBLE WALL	ASTM F-2736 D-3212, F-477
30-INCH TO 60-INCH TRIPLE WALL	ASTM F-2764 D3212, F-477

8. ALL SANITARY SEWER CONSTRUCTION (AND STORM SEWER CONSTRUCTION IN COMBINED SEWER AREAS), REQUIRES STONE BEDDING WITH STONE #4 TO 1/4" IN SIZE, WITH MINIMUM BEDDING THICKNESS EQUAL TO 1/2" OF THE PIPE DIAMETER. THE UNDERLAYER SHALL BE 1/4" THICK POLYETHYLENE OR 1/4" THICK POLYETHYLENE TUBE SUCH AS DOW TYPE F-191 OR EQUAL, AND MATERIAL SHALL BE STOCKPILED IN FRONT YARDS, DRAINAGE SITES, FLOOD ROADING AREAS, UTILITY LOCATIONS, AND/OR ESSENTIALS OR RIGHT-OF-WAY.

9. BAND SEAL OR SIMILAR NON-SHEAR FLEXIBLE-TYPE COUPLINGS SHALL BE USED IN THE CONNECTION OF SEWER PIPES OF DISSIMILAR MATERIALS (E.G. WITH PRECAST CONCRETE TO POLYPROPYLENE OR POLYETHYLENE).

10. ALL MANHOLES SHALL BE PROVIDED WITH BOLTED, WATER-TIGHT GASKETS; SANITARY LIDS SHALL BE CONSTRUCTED WITH A CONCEALED PICKLEHOLE AND WATER-TIGHT GASKET WITH THE WORD "SANITARY" CAST INTO THE LID.

11. WHEN CONNECTING TO AN EXISTING SEWER MAIN BY MEANS OTHER THAN AN EXISTING WYE, TEE, OR AN EXISTING MANHOLE, ONE OF THE FOLLOWING METHODS SHALL BE USED:

- A CIRCULAR SAW-CUT OF SEWER MAIN BY PROPER TOOLS ("SEWER-TAP" MACHINE OR SIMILAR) AND PROPER CUTTING TECHNIQUE.
- REMOVE AN ENTIRE SECTION OF PIPE (BREAKING INTO THE TOP OF ONE BELL) AND REPLACE WITH A WYE OR TEE BRANCH SECTION.
- WITH PIPE CUTTER, NEATLY AND ACCURATELY CUT OUT DESIRED LENGTH OF PIPE FOR INSERTION OF "PROPER FITTING, USING "BAND SEAL" OR SIMILAR COUPLINGS TO HOLD IT FIRMLY IN PLACE.

12. WHENEVER A SANITARY/COMBINED SEWER CROSSES UNDER A WATERMAIN, THE MINIMUM VERTICAL DISTANCE FROM THE TOP OF THE COVER TO THE BOTTOM OF THE WATERMAIN SHALL BE 18 INCHES. FURTHERMORE, A MINIMUM HORIZONTAL DISTANCE OF 10 FEET BETWEEN SANITARY/COMBINED SEWERS AND WATERMANS SHALL BE MAINTAINED UNLESS THE SEWER IS LAID IN SEPARATE TRENCH, KEEPING A MINIMUM 6" VERTICAL SEPARATION OR THE SEWER IS LAID IN THE SAME TRENCH WITH THE WATERMAIN LOCATED AT THE OPPOSITE SIDE ON A BENCH OF UNDISTURBED EARTH. THE MINIMUM HORIZONTAL DISTANCE BETWEEN THE VERTICAL OR HORIZONTAL DISTANCES DESCRIBED ABOVE CANNOT BE MAINTAINED, OR THE SEWER CROSSES ABOVE THE WATERMAIN, THE SEWER SHALL BE CONSTRUCTED TO THE WATERMAIN STANDARD.

13. ALL EXISTING SEPTIC SYSTEMS SHALL BE ABANDONED. ABANDONED TANKS SHALL BE FILLED WITH GRANULAR MATERIAL OR REMOVED.

14. ALL SANITARY MANHOLES, (AND STORM MANHOLES IN COMBINED SEWER AREAS), SHALL HAVE A MINIMUM INSIDE DIAMETER OF 18 INCHES, AND SHALL BE CAST IN PLACE OR PRE-CAST REINFORCED CONCRETE.

15. ALL SANITARY MANHOLES, (AND STORM MANHOLES IN COMBINED SEWER AREAS), SHALL HAVE PRECAST RUBBER GASKETS AND RUBBER GASKETS TO BE USED IN SEPARATE TRENCHES. PRECAST SECTIONS SHALL BE PROVIDED WITH MODIFIED TONGUE AND RUBBER GASKET TYPE JOINTS.

16. ALL ABANDONED SANITARY SEWERS SHALL BE PLUGGED AT BOTH ENDS WITH AT LEAST 2 FEET LONG NON-SHRINK CONCRETE OR MORTAR PLUGS.

17. EXCEPT FOR FOUNDATION/FLOODING DRAINS PROVIDED TO PROTECT BUILDINGS OR PERFORATED PIPES ASSOCIATED WITH VOLUME CONTROL FACILITIES, DRAIN TILES/FIELD TILES/UNDERDRAINS/PERFORATED PIPES ARE NOT ALLOWED TO BE CONNECTED TO ANY SEWER. ALL DRAIN TILES/FIELD TILES/UNDERDRAINS/PERFORATED PIPES SHALL BE TRIANGULAR TO COMBINED SEWERS IN COMBINED SEWER AREAS. CONSTRUCTION OF NEW FACILITIES OF THIS TYPE IS PROHIBITED. ALL DRAIN TILES/FIELD TILES/UNDERDRAINS/PERFORATED PIPES SHALL BE PLUGGED AT BOTH ENDS. THIS AREA SHALL BE PLUGGED OR REMOVED, AND SHALL NOT BE CONNECTED TO COMBINED SEWERS, SANITARY SEWERS, OR STORM SEWERS TRIBUTARY TO COMBINED SEWERS.

18. A BACKFLOW PREVENTER IS REQUIRED FOR ALL DETENTION BASINS TRIBUTARY TO COMBINED SEWERS. ENSURE BACKFLOW PREVENTER IS OF CORRECT PREVENTER AND EXERCISED ANNUALLY BY THE PROPERTY OWNER TO ENSURE PROPER OPERATION, AND ANY NECESSARY MAINTENANCE SHALL BE PERFORMED TO ENSURE FUNCTIONALITY IN THE EVENT OF A BACKFLOW. BACKFLOW PREVENTERS SHALL BE INSTALLED IN DETENTION BASINS TRIBUTARY TO COMBINED SEWERS. THE PERMITTEE SHALL ENSURE THAT CLEAN UP AND WASH OUT OF SEWAGE TAKES PLACE WITHIN 48 HOURS OF THE STORM EVENT.

EROSION AND SEDIMENT CONTROL

- THE CONTRACTOR SHALL INSTALL THE EROSION AND SEDIMENT CONTROL DEVICES AS SHOWN ON THE APPROVED EROSION AND SEDIMENT CONTROL PLAN.
- EROSION AND SEDIMENT CONTROL PRACTICES SHALL BE FUNCTIONAL PRIOR TO HYDROLOGIC DISTURBANCE OF THE SITE.
- ALL DESIGN CRITERIA, SPECIFICATIONS, AND INSTALLATION OF EROSION AND SEDIMENT CONTROL PRACTICES SHALL BE STABILIZED IN ACCORDANCE WITH THE ILLINOIS URBAN MANUAL.
- A COPY OF THE APPROVED EROSION AND SEDIMENT CONTROL PLAN SHALL BE MAINTAINED ON THE SITE AT ALL TIMES.
- INSPECTIONS AND DOCUMENTATION SHALL BE PERFORMED, AT A MINIMUM OF ONCE EVERY SEVEN (7) CALENDAR DAYS AND WITHIN 24 HOURS OF THE END OF A STORM EVENT AT WHICH GREATER THAN 0.5 INCH OF RAINFALL OR LIQUID EQUIVALENT PRECIPITATION.
- SOIL DISTURBANCE SHALL BE CONDUCTED IN SUCH A MANNER AS TO MINIMIZE EROSION, IF STRIPPING, CLEARING, GRADING, OR LANDSCAPING ARE TO BE DONE IN PHASES, THE COOPERATED SHALL PLAN FOR APPROPRIATE SOIL EROSION AND SEDIMENT CONTROL MEASURES.
- A STABILIZED MAT OF CRUSHED STONE MEETING THE STANDARDS OF THE ILLINOIS URBAN MANUAL SHALL BE MAINTAINED AT ANY POINT WHERE TRAFFIC WILL BE ENTERING OR LEAVING A CONSTRUCTION SITE. SEDIMENT OR SOIL REACHING AN IMPROVED PUBLIC RIGHT-OF-WAY STREET, ALLEY OR PARKING AREA SHALL BE REMOVED BY THE CONTRACTOR TO A STREET CLEANING AS ACCUMULATIONS WARRANT AND TRANSPORTED TO A CONTROLLED SEDIMENT DISPOSAL AREA.
- CONCRETE WASHOUT FACILITIES SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE ILLINOIS URBAN MANUAL AND SHALL BE INSTALLED PRIOR TO ANY ON-SITE CONSTRUCTION ACTIVITIES INVOLVING CONCRETE.
- TEMPORARY DIVERSIONS SHALL BE CONSTRUCTED AS NECESSARY TO DIRECT ALL RUNOFF FROM HYDROLOGICALLY DISTURBED AREAS TO AN APPROPRIATE DRAINAGE TRAP OR BASIN VOLUME CONTROL FACILITIES SHALL NOT BE USED AS TEMPORARY SEDIMENT BASINS.
- DISTURBED AREAS OF THE SITE WHERE CONSTRUCTION ACTIVITIES HAVE TEMPORARILY OR PERMANENTLY CEASED SHALL BE STABILIZED WITH TEMPORARY OR PERMANENT MEASURES WITHIN THIRTY (30) DAYS FOLLOWING THE COMPLETION OF SOIL DISTURBING ACTIVITIES.
- ALL FLOOD PROTECTION AREAS AND VOLUME CONTROL FACILITIES SHALL, AT A MINIMUM, BE PROTECTED WITH A DOUBLE-ROW OF SILT FENCE OR EQUIVALENT.
- VOLUME CONTROL FACILITIES SHALL NOT BE CONSTRUCTED UNTIL ALL OF THE CONTRIBUTING DRAINAGE AREA HAS BEEN STABILIZED.
- SOIL STOCKPILES SHALL, AT A MINIMUM, BE PROTECTED WITH PERIMETER SEDIMENT CONTROLS. SOIL STOCKPILES SHALL NOT BE PLACED IN FLOOD PROTECTION AREAS OR THEIR BUFFERS.
- EARTHEN EMBANKMENT SIDE SLOPES SHALL BE STABILIZED WITH APPROPRIATE EROSION CONTROL BLANKET.
- STORM SEWERS THAT ARE OR WILL BE FUNCTIONING DURING CONSTRUCTION SHALL BE PROTECTED BY APPROPRIATE SEDIMENT CONTROL MEASURES.
- THE CONTRACTOR SHALL EITHER REMOVE OR REPLACE ANY EXISTING DRAIN TILES AND INCORPORATE THEM INTO THE DRAINAGE PLAN FOR THE DEVELOPMENT. DRAIN TILES CANNOT BE TRIBUTARY TO A SANITARY OR COMBINED SEWER.
- IF DEWATERING SERVICES ARE USED, ADDITIONAL PROPERTIES AND DISCHARGE LOCATIONS SHALL BE PROTECTED FROM EROSION AND SEDIMENTATION. DEWATERING SYSTEMS SHOULD BE INSPECTED DAILY DURING OPERATIONAL PERIODS. THE SITE INSPECTOR MUST BE PRESENT AT THE COMMENCEMENT OF DEWATERING ACTIVITIES.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR TRENCH DEWATERING AND EXCAVATION FOR THE INSTALLATION OF SANITARY SEWERS, STORM SEWERS, WATERMANS AS WELL AS THEIR SERVICES AND OTHER APPLICANCES. ANY TRENCH DEWATERING, WHICH CONTAINS SEDIMENT SHALL PASS THROUGH A SEDIMENT TRAP OR DRAINAGE EFFECTIVE SEDIMENT CONTROL DEVICE. ALTERNATIVES MAY INCLUDE DEWATERING INTO A PUMP PIT, FILTER BAG OR EXISTING VEGETATED UPLAND AREA. SEDIMENT LAKEN WATER SHALL NOT BE DISCHARGE TO WATERWAYS, FLOOD PROTECTION AREAS OR THE COMBINED SEWER SYSTEM.
- ALL PERMANENT EROSION CONTROL PRACTICES SHALL BE INITIATED WITHIN SEVEN (7) DAYS FOLLOWING THE COMPLETION OF SOIL DISTURBING ACTIVITIES.
- ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE MAINTAINED AND REPAIRED AS NEEDED ON A YEAR-ROUND BASIS DURING CONSTRUCTION AND ANY PERIODS OF CONSTRUCTION SHUTDOWN UNTIL PERMANENT STABILIZATION IS ACHIEVED.
- ALL TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES SHALL BE REMOVED WITHIN THIRTY (30) DAYS AFTER PERMANENT SITE STABILIZATION.
- THE EROSION AND SEDIMENT CONTROL MEASURES SHOWN ON THE PLANS ARE THE MINIMUM REQUIREMENTS. ADDITIONAL MEASURES MAY BE REQUIRED, AS DIRECTED BY THE ENGINEER, SITE INSPECTOR, OR MWRD.

VI. PAVEMENT, CURBS, AND SIDEWALKS

UNLESS SPECIFICALLY NOTIFIED BELOW, ALL PAVEMENT, CURB, AND SIDEWALK CONSTRUCTION SHALL BE DONE IN ACCORDANCE WITH THE APPLICABLE SECTIONS OF THE "STANDARDS SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION IN ILLINOIS," AS PUBLISHED BY IDOT, LATEST EDITION.

SUBGRADE PREPARATION
 The subgrade for roadways, pavement, and/or curbs and walks shall be finished by the excavation contractor to whom all final subgrade and final inspection (cost incidental). The contractor shall conform to the proper preparation of the rough subgrade, or notify the owner and engineer in writing of any discrepancies. Prior to placement of base material, the paving contractor shall fine grade the subgrade to insure proper thicknesses for all base and pavement courses.

BITUMINOUS PAVEMENT
 Bituminous pavement shall consist of the sub-base course, base course, hot-mix asphalt binder course, and hot-mix pavement surface course, of the thickness and materials as specified on the plans. The maximum depth of any one layer shall not exceed 4 inches. The subgrade shall be prepared to receive the sub-base course (or base course) as indicated on the plans. A tack coat shall be applied to the subgrade prior to base course placement.

WEATHER RESISTANTS FOR BITUMINOUS PAVING
 Hot-mix binder shall be placed only when the ambient air temperature is at least 40 degrees Fahrenheit and the forecast is for rising temperatures. Hot-mix surface shall be placed when the ambient air temperature is at least 45 degrees Fahrenheit and the forecast is for rising temperatures.

BITUMINOUS PAVEMENT INSTALLATION
 After installation of the base course, all traffic shall be kept off the base until the binder course is placed. After installation of the binder course, the subgrade and surface course shall be placed in accordance with applicable governmental agency and owner, the binder shall be cleaned, a tack coat shall be applied to a rate of 0.05 square yards per square yard. The binder shall be placed. All damaged areas in the binder, base or curb shall be repaired prior to surface placement.

BITUMINOUS PAVEMENT INSTALLATION
 After installation of the base course, all traffic shall be kept off the base until the binder course is placed. After installation of the binder course, the subgrade and surface course shall be placed in accordance with applicable governmental agency and owner, the binder shall be cleaned, a tack coat shall be applied to a rate of 0.05 square yards per square yard. The binder shall be placed. All damaged areas in the binder, base or curb shall be repaired prior to surface placement.

19. ALL SANITARY SEWER PIPE MATERIALS AND JOINTS (AND STORM SEWER PIPE MATERIALS AND JOINTS IN A COMBINED SEWER AREA) SHALL CONFORM TO THE FOLLOWING:

PIPE SPECIFICATIONS	JOINT SPECIFICATIONS
VITRIFIED CLAY PIPE	ASTM C-700 ASTM C-425
REINFORCED CONCRETE SEWER PIPE	ASTM C-76 ASTM C-443
CAST IRON SOIL PIPE	ASTM A-74 ASTM C-564
DUCTILE IRON PIPE	ANSI A2151 ANSI A2111
POLYVINYL CHLORIDE (PVC) PIPE	ASTM D-3034 ASTM D-3212
6-INCH TO 15-INCH DIAMETER SDR 26	ASTM F-679
18-INCH TO 27-INCH DIAMETER F721+46	ASTM F-679
HIGH DENSITY POLYETHYLENE (HDPE)	ASTM D-3350 ASTM D-3052
WATER MAIN QUALITY PVC	ASTM D-2241
4-INCH TO 12-INCH	AWWA C200
14-INCH TO 48-INCH	AWWA C205

1. THE CONTRACTOR SHALL TAKE MEASURES TO PREVENT ANY POLLUTED WATER, SUCH AS GROUND AND SURFACE WATER, FROM ENTERING THE EXISTING SANITARY SEWERS.

2. A WATER-TIGHT PLUG SHALL BE INSTALLED IN THE DOWNSTREAM SEWER PIPE AT THE POINT OF SEWER CONNECTION PRIOR TO COMMENCING ANY SEWER CONSTRUCTION. THE PLUG SHALL REMAIN IN PLACE UNTIL REMOVAL IS AUTHORIZED BY THE MUNICIPALITY AND/OR MWRD AFTER THE SEWERS HAVE BEEN TESTED AND ACCEPTED.

3. DISCHARGING ANY UNPOLLUTED WATER INTO THE SANITARY SEWER FOR THE PURPOSE OF SEWER TESTING OR FOR THE PURPOSE OF THE DEFLECTION TEST SHALL BE PROHIBITED WITHOUT PRIOR APPROVAL FROM THE MUNICIPALITY OR MWRD.

4. ALL SANITARY SEWER CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS FOR WATER AND SEWER MAIN CONSTRUCTION IN ILLINOIS (LATEST EDITION).

5. ALL FLOOR DRAINS SHALL DISCHARGE TO THE SANITARY SEWER SYSTEM.

6. ALL DOWNSPOUTS AND FOOTING DRAINS SHALL DISCHARGE TO THE STORM SEWER SYSTEM.

7. ALL SANITARY SEWER PIPE MATERIALS AND JOINTS (AND STORM SEWER PIPE MATERIALS AND JOINTS IN A COMBINED SEWER AREA) SHALL CONFORM TO THE FOLLOWING:

PIPE SPECIFICATIONS	JOINT SPECIFICATIONS
VITRIFIED CLAY PIPE	ASTM C-700 ASTM C-425
REINFORCED CONCRETE SEWER PIPE	ASTM C-76 ASTM C-443
CAST IRON SOIL PIPE	ASTM A-74 ASTM C-564
DUCTILE IRON PIPE	ANSI A2151 ANSI A2111
POLYVINYL CHLORIDE (PVC) PIPE	ASTM D-3034 ASTM D-3212
6-INCH TO 15-INCH DIAMETER SDR 26	ASTM F-679
18-INCH TO 27-INCH DIAMETER F721+46	ASTM F-679
HIGH DENSITY POLYETHYLENE (HDPE)	ASTM D-3350 ASTM D-3052
WATER MAIN QUALITY PVC	ASTM D-2241
4-INCH TO 12-INCH	AWWA C200
14-INCH TO 48-INCH	AWWA C205

V. UNDERGROUND UTILITIES - WATER MAIN

WATER MAIN PIPE
 Water main shall be cement-lined duct iron pipe class 52 conforming to AWWA C-151 (ANSI A2151). Rubber gasket joints shall conform to AWWA C-111 (ANSI A2111). Push-in pipe joints shall incorporate "Field Lock" gaskets by US Pipe and Foundry Series 1700. Ductile iron pipe shall conform to AWWA C-110 (ANSI A2110). Cement lining shall conform to AWWA C-104 (ANSI A214). Protective wrapping is required. It shall conform to AWWA C109-99, minimum thickness 8 mil polyethylene tube such as Dow type F-191 or equal, and material shall be stockpiled in front yards, drainage areas, flood roadway areas, utility locations, and/or essentials or right-of-way.

FITTINGS
 Water main fittings (bends, elbows, tees, reducers, etc.) may or may not be specifically identified on the plans and quantities are as shown. If not, they shall be considered incidental and included in the lineal footage cost for the water main.

UNDESIRABLE MATERIAL
 Undesirable subgrade material shall be removed from roadway, driveway, parking lot, building pad, and any other designated areas. Obviously soft underlying soil shall be removed from all structural improvement areas. Areas to be excavated shall be filled and underlaid with structure grade subgrade. Subgrade shall be compacted to a minimum of 95% relative compaction. Failure to properly compact, or failure to use the proper equipment, shall be considered a violation of the contract.

EXCAVATION AND EMBANKMENT
 Upon completion of topsoil removal, the contractor shall perform excavation and embankment (fill) operations in accordance with the improvement plans.

EMPALEMENT MATERIAL
 Structural embankment material shall be placed in level uniform layers so that the compacted thickness is approximately six inches. Each layer shall be thoroughly mixed during spreading to insure uniformity.

EMPALEMENT MATERIAL WITHIN ROADWAY
 Embankment material within roadway, driveway, parking area, and other structural city fill areas shall be compacted to a minimum of ninety percent (90%) of maximum density (modified proctor method), or to such other density as determined appropriate by the soils engineer. Embankment for building pads shall be compacted to a minimum of ninety-five percent (95%) of maximum density (modified proctor method), or to such other density as determined appropriate by the soils engineer.

EMPALEMENT MATERIAL WITHIN NON-STRUCTURAL FILL AREAS
 Embankment material within non-structural fill areas (random fill) shall be compacted to a minimum of eighty-five percent (85%) of maximum density (modified proctor method), or to such other density as determined appropriate by the soils engineer.

EMPALEMENT MATERIAL WITHIN NON-STRUCTURAL FILL AREAS
 Embankment material within non-structural fill areas (random fill) required to raise the ground surface to or above the base (100 year) flood elevation shall be compacted to a minimum of ninety percent (90%) of maximum density (modified proctor method).

BACKFILLING CURBS, PAVEMENT, ETC.
 Backfilling of curbs, pavement, etc., shall be backfilled by the contractor after installation in accordance with the improvement plan details.

DESIGN RESURFACE
 Upon completion of topsoil removal, the contractor shall resurface a minimum six (6) inch layer of topsoil on all designated open space, parkway, landscape, and other non-structural areas.

EXCESS MATERIAL
 Unless otherwise approved by the owner, the contractor shall remove from the site any excess or undesirable earth material.

SEEDING
 Upon completion of topsoil resurfacing, the contractor shall install seed and fertilizer as indicated on these improvement plans to insure proper seed and fertilizer landscape plans.

INSPECTION BY THE SOILS ENGINEER
 The owner provided soils engineer shall closely supervise and inspect the grading operations, particularly during the removal and replacement of topsoil, and during the construction of embankments or building pads, or any testing, inspection and supervision of embankment quality, unsuitable removal and replacement, and other soils related operations shall be entirely the responsibility of the soils engineer.

GRADE PREPARATION
 Rough grading to within one foot of finished subgrade shall be completed by the earthwork contractor prior to commencement of underground utility construction.

REINFORCEMENT
 The contractor is responsible for detouring any excavation for the installation of sewer or water structures. Detouring will be considered incidental to the respective underground utility construction.

SHEETING AND BRACING
 All excavation bracing and sheeting shall be reflected in the contract amounts. Additional costs for sheeting and bracing will not be allowed.

SELECT GRANULAR BACKFILL
 Utility trenches beneath existing or proposed pavement, driveways and sidewalks, and existing or proposed utilities (ie. crossings), and for a distance of three (3) feet either side of same (or more for deeper utilities as noted on the plans), and/or wherever else show be indicated on the plans, shall be backfilled with select granular material and firmly compacted in accordance with the construction standard details.

EXCESS TRENCH MATERIAL
 The contractor shall remove excess excavated trench material adjacent to the trenches in an orderly fashion so as not to create a hazard or obstruction, and to maintain the site in a workable condition.

DISSIMILAR MATERIALS/PIPE CONNECTIONS
 "Band-seal" or similar flexible type couplings shall be used when connecting sewer pipes of dissimilar materials. When connecting to an existing sewer main by means other than an existing wye, tee, or an existing structure, one of the following methods shall be used:

- REMOVE AN ENTIRE SECTION OF PIPE (BREAKING INTO THE TOP OF ONE BELL) AND REPLACE WITH PRECAST WYE OR TEE BRANCH SECTION.
- WITH PIPE CUTTER, NEATLY AND ACCURATELY CUT OUT DESIRED LENGTH OF PIPE FOR INSERTION OF PROPER FITTING, USING A NON-SHEAR MISSION COUPLING TO HOLD ASSEMBLY FIRMLY IN PLACE.

UTILITY STRUCTURE SELECT BACKFILL
 All utility structures (grates, bedding and backfill) is required ground utility structures, the cost for same shall be included in the structure cost.

STRUCTURE CASTINGS
 Frames and lids (or grates) for sanitary, water main and storm sewer structures shall be as indicated on the plans, and the cost of same shall be included in the structure cost.

ADJUSTING RINGS
 All structures shall incorporate a minimum of three (3) inches and a maximum of eight (8) inches of bedding (two (2) rings maximum).

STRUCTURE ADJUSTMENT
 All top of frames for utility structures (including B-boxes) shall be adjusted to meet final finished grade per the approved grading and final inspection (cost incidental). The contractor shall insure that roadway, curb, and pavement inlets or structures (frames and grates) are at finished grade.

HORIZONTAL AND VERTICAL SEPARATION OF WATER AND SEWER MAINS
 Horizontal and vertical separation between water and sewer mains shall be maintained in accordance with the Standard Specifications for Water and Sewer Main Construction in Illinois and said specifications standard drawings 18, 19, 20, 21, 22, 23, and 24.

FLOOR DRAINS AND FOOTING DRAINS
 All floor drains and footing drain sump pumps shall discharge into the sanitary sewer. All downspouts, footing drains and subsurface stormwater shall discharge into the storm sewer or onto the ground - not into the sanitary sewer.

RIP RAP MATERIAL
 Stone Rip-Rap material provided shall conform to IDOT specifications.

CONSTRUCTION RECORD
 The contractor shall maintain a legible record on a set of construction plans information concerning all manholes, eyes and services, valve boxes, curb boxes, etc. such that they can be field located in a manner acceptable to the applicable governmental agency.

IV. UNDERGROUND UTILITIES - SANITARY SEWER

SANITARY SEWER PIPE
 Sanitary sewers and services (or combined sewers in combined sewer areas) shall be constructed of one or more of the following materials as specified on the plans:

- PVC gravity sewer pipe conforming to ASTM D-3034 for pipe diameters of 4 inch to 15 inch, or ASTM F-679 for pipe diameters of 18 inch to 48 inch.
- Elastomeric gasket joints conforming to ASTM D-3212.
- The gasket shall comply with ASTM F-477.
- Sanitary sewers shall conform to ASTM D-2680 and D-2751 with solvent cement welded joints conforming to ASTM C-1111 (ANSI A2111).
- Cement-lined ductile iron pipe class 52, conforming to AWWA C-151 (ANSI 2151) with push-on joints conforming to AWWA C-111 (ANSI A2111).

SANITARY SEWER BEDDING
 Sanitary sewers shall be installed on compacted granular crushed stone bedding, 1/4 inch to 3/4 inch in size (DOT gravels) (D41 or D410) with a minimum thickness of one-fourth of the outside pipe diameter, but not less than 4 inches nor more than 8 inches. Bedding shall extend to one foot above the top of the pipe for sanitary sewer and services. Cost for bedding shall be merged into lineal footage cost for the respective sewer pipe.

SANITARY PIPE MANHOLE CONNECTIONS
 Manhole connections shall be made with a flexible water-tight boot precast into the structure (see construction standard details). Refer to ASTM C-923.

SERVICE CONNECTIONS TO MAINLINE SEWER
 Service connections to mainline sewer shall be done with pre-cast eyes or tees manufactured for that purpose, and shall be of the same material as the mainline sewer.

SANITARY SERVICES
 Services shall be laid to a minimum grade of 1.0 percent. The end of the service shall be sealed with a water-tight plug.

SERVICE LOCATIONS
 Sanitary services shall be installed in a separate trench from water services, with a minimum horizontal separation of 10 feet.











RWG ENGINEERING, LLC
 PROJECT SPECIFICATIONS

GENERAL CONDITIONS

CONTRACT DOCUMENTS
 The Standard Specifications listed on the title sheet, these Improvement Plans, the Special Provisions, General Conditions, and Subsequent Details are all part of the Contract Documents. Incidental Items or accessories necessary to complete the work may not be specifically noted, but are to be considered a part of the contract.

USE OF IMPROVEMENT PLANS
 No Improvement Plans shall be used for construction unless specifically marked "For Construction." Prior to commencement of construction, the contractor shall verify all dimensions and conditions affecting their work with the actual conditions at the job site. If there are discrepancies from what is shown on the construction plans, the contractor shall immediately report same to the engineer before doing any work, otherwise the contractor assumes full responsibility. In the event of disagreement between the construction plans, standard specifications, and/or contract details, the contractor shall proceed as written instructions from the engineer prior to proceeding with any part of the work impacted by omissions or discrepancies. Failure to accurately report same to the engineer shall be considered a violation of the contract and any risk and expense. In the event of any doubt or question with respect to the true meaning or interpretation of the construction plans or specifications, the decision of the engineer shall be final and conclusive.

UTILITY UTILITIES

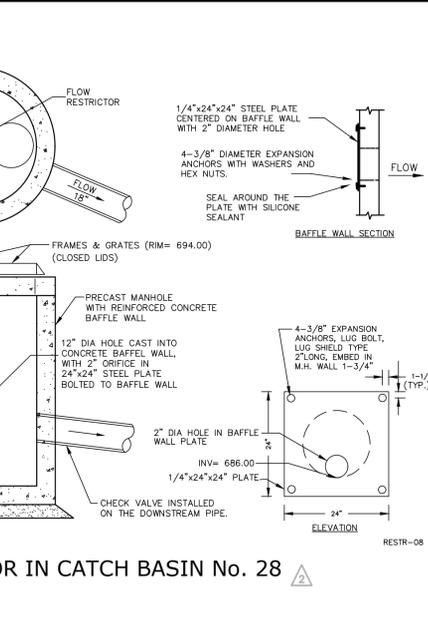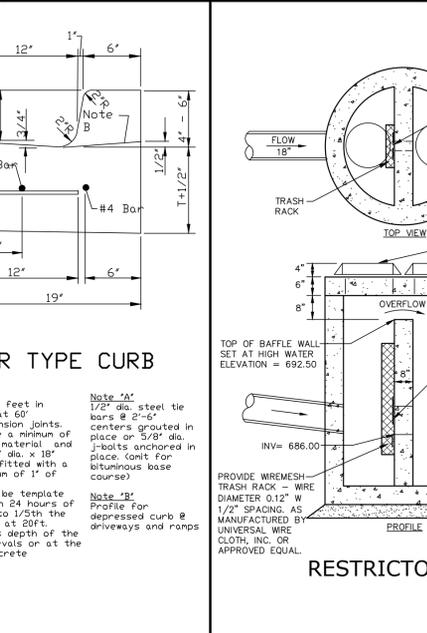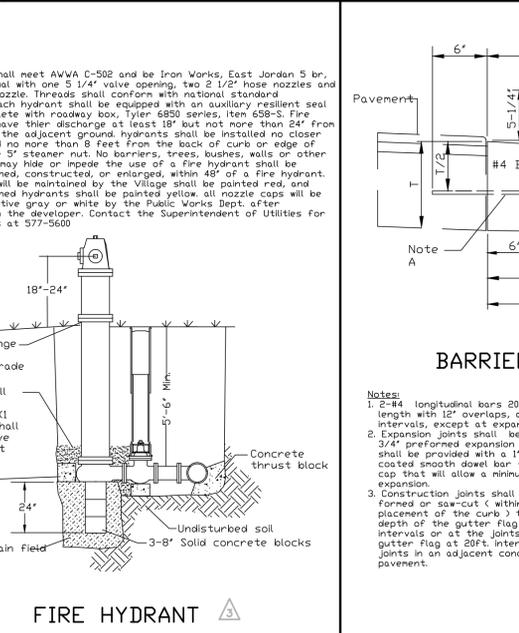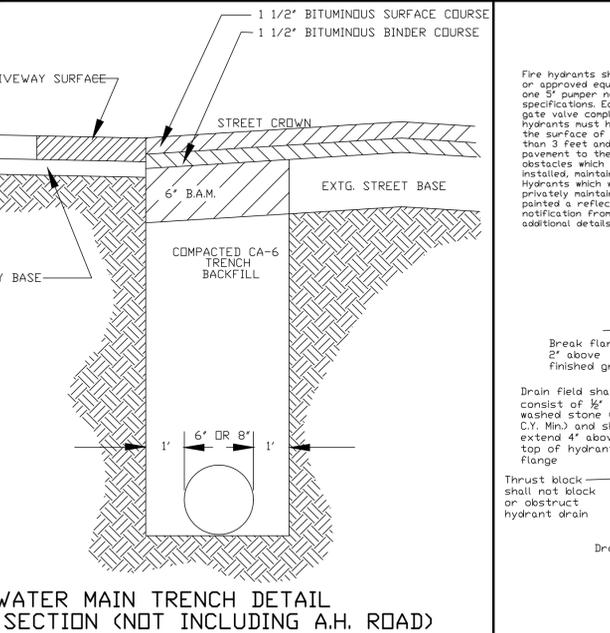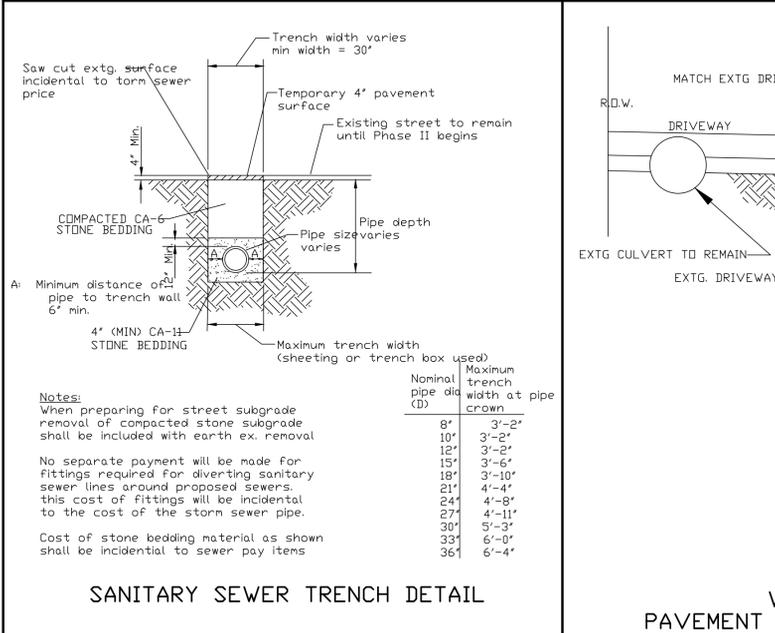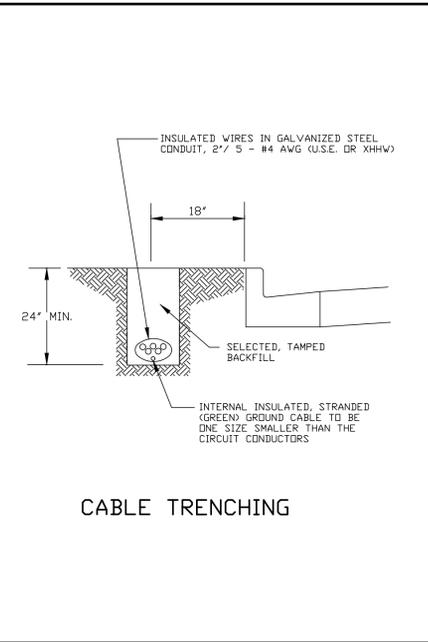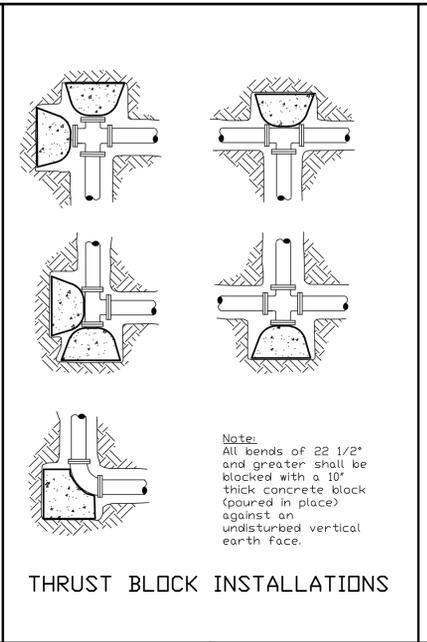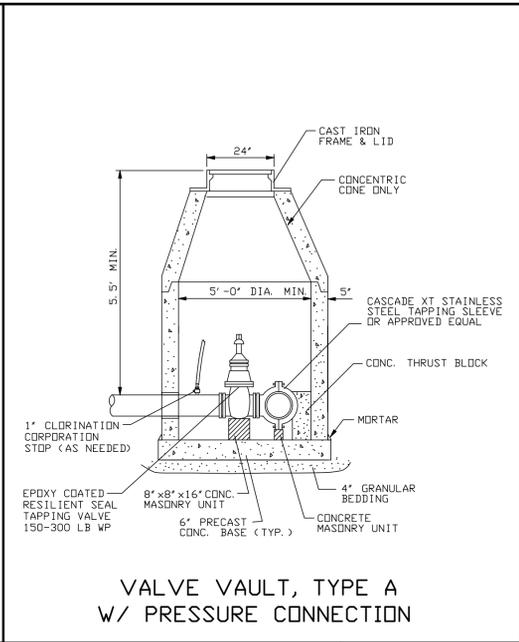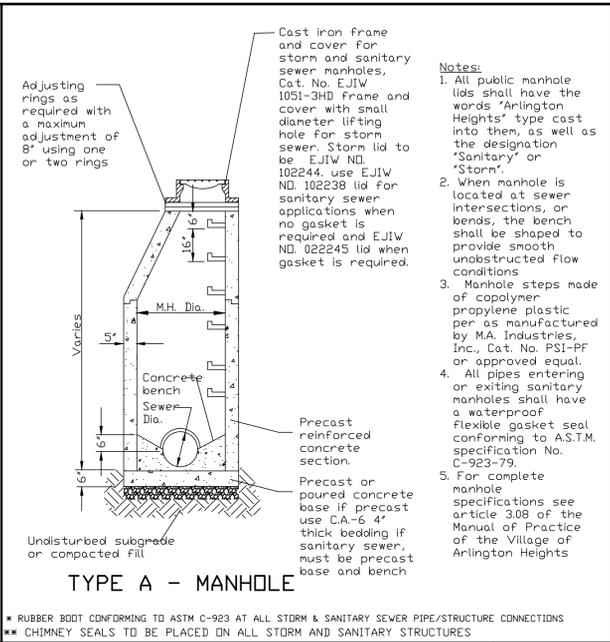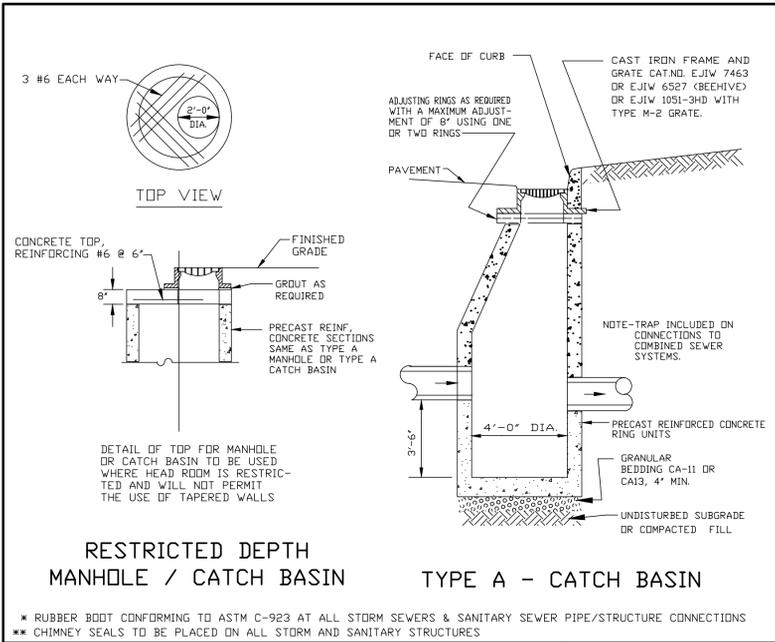

ITEM	QTY.	DESCRIPTION	MAT'L
1	1	ULTRAFLEX CHECKMATE CHECK VALVE	MUST BE SUPPLIED
2	1	CLAMP	MUST BE SUPPLIED

NOTES:

- PIPE INSIDE DIAMETER - MUST BE SUPPLIED (MINIMUM ALLOWABLE PIPE DIAMETER = 17.25 INCHES)
- CLAMP INSTALLED IN UPSTREAM OR DOWNSTREAM CURF DEPENDING ON INSTALLATION ORIENTATION
- MAXIMUM ALLOWABLE BACK PRESSURE = 56.0 FEET
- IT IS RECOMMENDED TO BOLT OR PIN CHECKMATE TO PIPE AS SHOWN, 4 PLACES 90° APART

PRELIMINARY DRAWING NOT FOR APPROVAL PURPOSES



Tideflex
A Division of Red Valve Company, Inc.
600 N. BELL AVE., CARNEGIE, PA. 15106
info@tideflex.com 412.279.0044
fax 412.279.5410

OPPORTUNITY No: XXXXX SALES ORDER No: TXX-XXXX
IT PART No: CMCBUF-180-APPROVAL
DR. BY: TLM DATE: 2-9-17 CHKD. BY: DATE:
CAD SCALE: FULL PLOT SCALE: 1 = 1 DWG No: TIS-XXXX

*** PATENT PENDING ***

PROPRIETARY NOTICE: THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF TIDEFLEX TECHNOLOGIES. IT IS LOANED BY TIDEFLEX TECHNOLOGIES, SUBJECT TO THE CONDITIONS THAT IT AND THE INFORMATION EMBODIED THEREIN SHALL BE USED ONLY FOR RECORD AND REFERENCE PURPOSES. IT SHALL NOT BE USED OR COPIED TO BE USED IN ANY MANNER PREJUDICIAL TO THE INTERESTS OF TIDEFLEX TECHNOLOGIES. IT SHALL NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART, OR DISCLOSED TO ANYONE WITHOUT THE DIRECT WRITTEN PERMISSION OF TIDEFLEX TECHNOLOGIES AND SHALL BE RETURNED UPON REQUEST.

CUSTOMER: XXX ORDER No: XXX

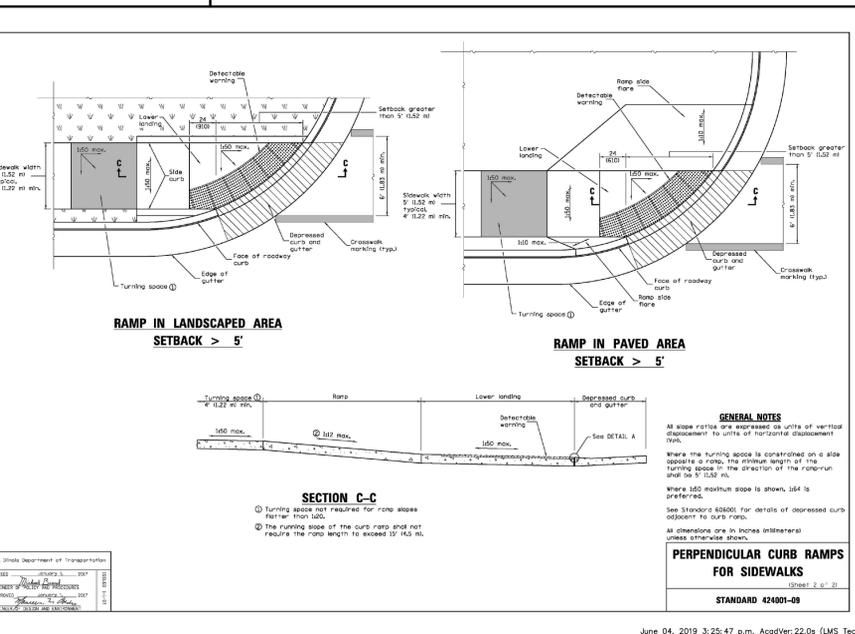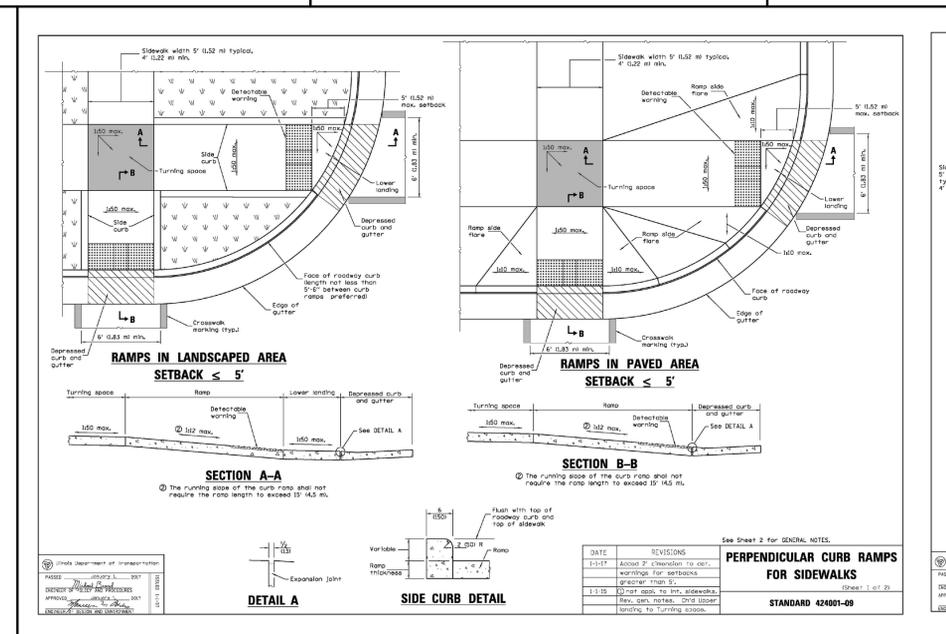

SIGWALT 16
ARLINGTON HEIGHTS, ILLINOIS
CONSTRUCTION DETAILS AND STANDARDS

975 E. 22nd St., Suite 400
Wheaton, IL 60189
630.480.7889
www.rwg-engineering.com

Engineering, LLC
Civil Engineering • Real Estate Consulting • Project Management

PROJECT No. 42905219
DATE: 04/12/19
SCALE: NONE
PROJ. MGR.: RWG
PROJ. ASSOC.: MRM
DRAWN BY: TLM

RWG

SHEET 9 OF 10

PROJECT INFORMATION	
ENGINEER	DATE
PROJECT MANAGER	DATE
SALES REP	DATE
SALES MANAGER	DATE
PROJECT NO.	DATE



SINGWALT TOWNHOMES - OPTIMAL

ARLINGTON HEIGHTS, IL

STORMTECH CHAMBER SPECIFICATIONS

- CHAMBERS SHALL BE STORMTECH MC-4500.
- CHAMBERS SHALL BE MANUFACTURED FROM VIRGIN, UNMODIFIED POLYPROPYLENE COPOLYMERS.
- CHAMBER ROWS SHALL PROVIDE CONTINUOUS, UNINTERRUPTED INTERNAL SPACE WITH NO INTERNAL SUPPORT PANELS THAT WOULD INTERFERE WITH FLOW OR LIMIT ACCESS FOR INSPECTION.
- THE STRUCTURAL DESIGN OF THE CHAMBERS, THE STRUCTURAL BACKFILL, AND THE INSTALLATION REQUIREMENTS SHALL ENSURE THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET FOR 1) LONG-DURATION (DEAD) LOADS AND 2) SHORT-DURATION LIVE LOADS, BASED ON THE AASHTO DESIGN TRUCK WITH CONSIDERATION FOR BRACK AND MULTIPLE VEHICLE PRESSIONS.
- CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F1414, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- CHAMBERS SHALL BE DESIGNED AND ALLOWABLE LOADS DETERMINED IN ACCORDANCE WITH ASTM F2781, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
- ONLY CHAMBERS THAT ARE APPROVED BY THE SITE DESIGN ENGINEER SHALL BE ALLOWED. THE CHAMBER MANUFACTURER SHALL SUBMIT THE FOLLOWING FOR REVIEW TO THE SITE DESIGN ENGINEER FOR APPROVAL BEFORE CONSTRUCTION OF THE PROJECT SITE:
 - A STRUCTURAL EVALUATION PERFORMED BY A REGISTERED PROFESSIONAL ENGINEER THAT DEMONSTRATES THAT THE SAFETY FACTORS ARE GREATER THAN OR EQUAL TO 1.5 FOR DEAD LOAD AND 1.75 FOR LIVE LOADS. THE MINIMUM REQUIRED BY ASTM F2781 SHALL BE MAINTAINED.
 - A STRUCTURAL EVALUATION PERFORMED BY A REGISTERED PROFESSIONAL ENGINEER THAT DEMONSTRATES THAT THE LOAD FACTORS SPECIFIED IN THE AASHTO DESIGN SPECIFICATIONS, SECTION 12.12, ARE MET. THE 50 YEAR GLEPP MODULUS DATA SPECIFIED IN ASTM F2781 MUST BE USED AS PART OF THE AASHTO STRUCTURAL EVALUATION TO VERIFY LONG-TERM PERFORMANCE.
 - STRUCTURAL CROSS-SECTION DETAIL ON WHICH THE STRUCTURAL EVALUATION IS BASED.
- CHAMBERS AND END CAPS SHALL BE PRODUCED AT AN ISO 9001 CERTIFIED MANUFACTURING FACILITY.


IMPORTANT NOTES FOR THE BIDDING AND INSTALLATION OF MC-4500 CHAMBER SYSTEM

- STORMTECH MC-4500 CHAMBERS SHALL NOT BE INSTALLED UNTIL THE MANUFACTURER'S REPRESENTATIVE HAS COMPLETED A PRE-CONSTRUCTION MEETING WITH THE CONTRACTOR.
- STORMTECH MC-4500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3300/MC-4500 CONSTRUCTION GUIDE".
- CHAMBERS ARE NOT TO BE BACKFILLED WITH A DOZER OR EXCAVATOR SITUATED OVER THE CHAMBERS. STORMTECH RECOMMENDS 3 SHOULDER METHODS:
 - STONE DOZER LOCATED OFF THE CHAMBER BED.
 - BACKFILL AS ROWS ARE LAYED USING AN EXCAVATOR ON THE FOUNDATION STONE OR SUBGRADE.
 - BACKFILL FROM THE EXCAVATION USING A LOW BOOMER EXCAVATOR.
- THE FOUNDATION STONE SHALL BE LEVELLED AND COMPACTED PRIOR TO PLACING CHAMBERS.
- JOINTS BETWEEN CHAMBERS SHALL BE PROPERLY SEALED PRIOR TO PLACING STONE.
- MAINTAIN MINIMUM 6" (200 mm) SPACING BETWEEN THE CHAMBER ROWS.
- INLET AND OUTLET MANIFOLDS MUST BE INSERTED A MINIMUM OF 12" (300 mm) INTO CHAMBER END CAPS.
- EMBEDMENT STONE SURROUNDING CHAMBERS MUST BE A CLEAN, CRUSHED, ANGULAR STONE 3/4" (20-50 mm) MEETING THE AASHTO M30 DESIGNATION OF # 57 OR # 4.
- STONE SHALL BE BROUGHT UP EVENLY AROUND CHAMBERS SO AS NOT TO DISTORT THE CHAMBER SHAPE. STONE DEPTH SHOULD NEVER EXCEED 12" (300 mm) UNLESS OTHERWISE SPECIFIED BY THE SITE DESIGN ENGINEER.
- STONE MUST BE PLACED ON THE TOP CENTER OF THE CHAMBER TO ANCHOR THE CHAMBERS IN PLACE AND PRESERVE ROW SPACING.
- THE CONTRACTOR MUST REPORT ANY DISCREPANCIES WITH CHAMBER FOUNDATION MATERIAL BEARING CAPACITIES TO THE SITE DESIGN ENGINEER.
- ADS RECOMMENDS THE USE OF "PULSIFORM CATCH-T" INSERTS DURING CONSTRUCTION FOR ALL INLETS TO PROTECT THE SUBSURFACE STORMWATER MANAGEMENT SYSTEM FROM CONSTRUCTION SITE RUNOFF.

NOTES FOR CONSTRUCTION EQUIPMENT

- STORMTECH MC-4500 CHAMBERS SHALL BE INSTALLED IN ACCORDANCE WITH THE "STORMTECH MC-3300/MC-4500 CONSTRUCTION GUIDE".
 - THE USE OF EQUIPMENT OVER MC-4500 CHAMBERS IS LIMITED:
 - NO EQUIPMENT SHALL BE DRIVEN OVER CHAMBERS.
 - NO RUBBER TREAD TRACKS, CLAMP TRUCKS OR EXCAVATORS ARE ALLOWED UNTIL PROPER FILL DEPTHS ARE REACHED IN ACCORDANCE WITH THE "STORMTECH MC-3300/MC-4500 CONSTRUCTION GUIDE".
 - BACKFILLING WITH CONSTRUCTION EQUIPMENT CAN BE PERFORMED IN THE "STORMTECH MC-3300/MC-4500 CONSTRUCTION GUIDE".
 - FILL 30" (900 mm) OF STABLE, DRY COVER MATERIALS OVER THE CHAMBERS IS REQUIRED FOR CLAMP TRUCK TRAVEL OR DUMPING.
- USE OF A DOZER TO PUMP EMBEDMENT STONE BETWEEN THE ROWS OF CHAMBERS MAY CAUSE DAMAGE TO CHAMBERS AND IS NOT AN ACCEPTABLE WARRANTY.
- CONTACT STORMTECH AT 1-888-828-2894 WITH ANY QUESTIONS ON INSTALLATION REQUIREMENTS OR WEIGHT LIMITS FOR CONSTRUCTION EQUIPMENT.

NO.	DESCRIPTION	QTY	UNIT	PRICE	TOTAL
29	STORMTECH MC-4500 CHAMBERS	850	EA	850.00	722,500.00
30	STORMTECH MC-4500 END CAPS	100	EA	100.00	10,000.00
31	STORMTECH MC-4500 MANIFOLDS	100	EA	100.00	10,000.00
32	STORMTECH MC-4500 INSERTS	100	EA	100.00	10,000.00
33	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
34	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
35	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
36	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
37	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
38	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
39	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
40	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00

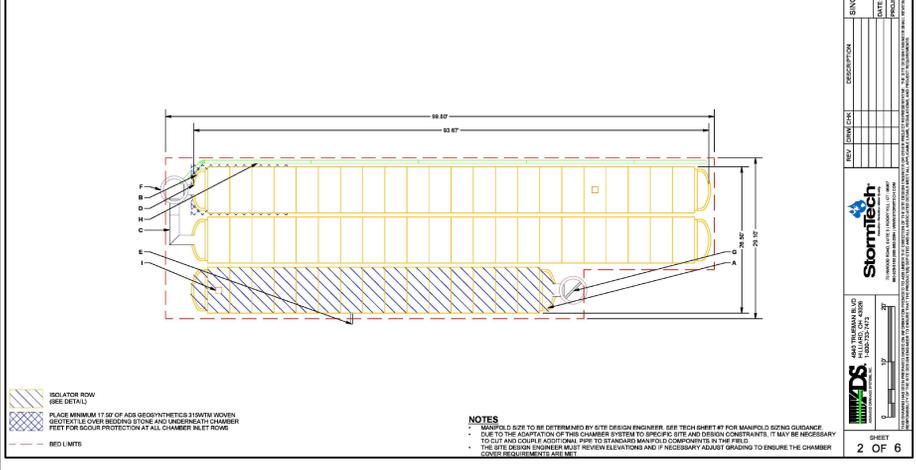


NO.	DESCRIPTION	QTY	UNIT	PRICE	TOTAL
41	STORMTECH MC-4500 CHAMBERS	850	EA	850.00	722,500.00
42	STORMTECH MC-4500 END CAPS	100	EA	100.00	10,000.00
43	STORMTECH MC-4500 MANIFOLDS	100	EA	100.00	10,000.00
44	STORMTECH MC-4500 INSERTS	100	EA	100.00	10,000.00
45	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
46	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
47	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
48	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
49	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00
50	STORMTECH MC-4500 TEE'S	100	EA	100.00	10,000.00


MATERIAL LOCATION	DESCRIPTION	AASHTO MATERIAL CLASSIFICATIONS	COMPACTION / DENSITY REQUIREMENT
D	FINAL FILL MATERIAL FOR LAYER 1 (STARTS FROM THE TOP OF THE 1" LAYER TO THE BOTTOM OF FLEXIBLE PAVEMENT OR UNPAVED FINISHED GRADE AND NOTE THAT PAVEMENT SUBGRADE MAY BE PART OF THE 1" LAYER)	N/A	PREPARE PER SITE DESIGN REQUIREMENTS. PAVED INSTALLATIONS MAY HAVE STRENGTHENED MATERIAL AND PREPARED REQUIREMENTS.
C	FINAL FILL MATERIAL FOR LAYER 2 (STARTS FROM THE TOP OF THE EMBEDMENT STONE TO THE TOP OF THE 1" LAYER)	AASHTO M37 A1, A2, A-3 OR AASHTO M37 3, 3S7, 4, 4S7, 5, 5L, 57, 6, 6L, 67, 7, 7L, 8, 8L, 9, 9S	85% COMPACTED AT 1% (90 mm) OF MATERIAL OVER THE CHAMBERS IS REQUIRED. CHECK ADDITIONAL LAYERS IN 1" LAYER MAX (PTS TO A MIN. 0.8% PROCTOR DENSITY FOR WELL GRADED MATERIAL AND IN 1" LAYER DENSITY FOR PROCESSED AGGREGATE MATERIALS).
B	EMBEDMENT STONE: FILL SURROUNDING THE CHAMBERS FROM THE FOUNDATION STONE (4" LAYERS TO THE 1" LAYER ABOVE)	AASHTO M37 3, 4	NO COMPACTION REQUIRED.
A	FOUNDATION STONE: FILL BELOW CHAMBERS FROM THE SUBGRADE UP TO THE FOOT (BOTTOM) OF THE CHAMBER	AASHTO M37 3, 4	PLATE COMPACT OR ROLL TO ACHIEVE A FLAT SURFACE. **






- PLEASE NOTE:
- THE LISTED AASHTO DESIGNATIONS ARE FOR GRADATIONS ONLY. THE STONE MUST ALSO BE CLEAN, CRUSHED, ANGULAR, AND UNWEARABLE.
 - ACCEPTABLE FILL MATERIALS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2781, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
 - STORMTECH CORPORATION REQUIREMENTS ARE MET FOR ALL LOCATION MATERIALS WITHIN PLACES AND COMPACTED IN 4" (200 mm) MAXIMUM LIFTS USING TWO FULL COVERAGES WITH A VIBRATORY COMPACTOR WHERE APPLICABLE. SUBGRADE MAY BE COMPROMISED BY CONSTRUCTION FOR STRENGTHENED LOAD-CARRYING. A 4" (100 mm) SURFACE MAY BE ACHIEVED BY RAMPING OR DRAGGING WITHOUT CONSTRUCTION EQUIPMENT. FOR SPECIAL LOAD DESIGNS, CONTACT STORMTECH FOR COMPACTION REQUIREMENTS.

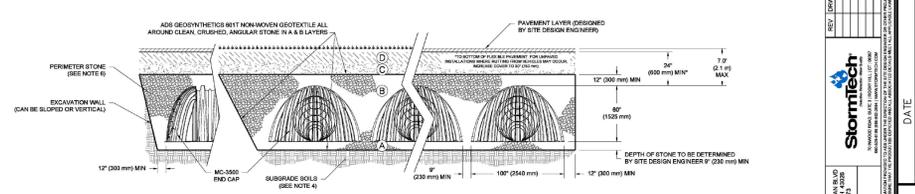

- NOTES:
- MC-4500 CHAMBERS SHALL CONFORM TO THE REQUIREMENTS OF ASTM F1414, "STANDARD SPECIFICATION FOR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
 - MC-4500 CHAMBERS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2781, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
 - ACCEPTABLE FILL MATERIALS SHALL BE DESIGNED IN ACCORDANCE WITH ASTM F2781, "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
 - THE SITE DESIGN ENGINEER IS RESPONSIBLE FOR ASSESSING THE BEARING CAPACITY OF THE SUBGRADE SOILS AND THE DEPTH OF FOUNDATION STONE WITH CONSIDERATION FOR THE RANGE OF EXPECTED SOIL MOISTURE CONDITIONS.
 - ONCE LAYER "C" IS PLACED, ANY SOLID MATERIAL CAN BE PLACED IN LAYER "D" UP TO THE FINISHED GRADE. MOST PAVEMENT SUBGRADE SOLS CAN BE USED TO REPLACE THE MATERIAL REQUIREMENTS OF LAYER "C" OR "D" AT THE SITE DESIGN ENGINEER'S DISCRETION.
 - PERMITTER STONE MUST BE EXTENDED HORIZONTALLY TO THE EXCAVATION WALL FOR BOTH VERTICAL AND SLOPED EXCAVATION WALLS.

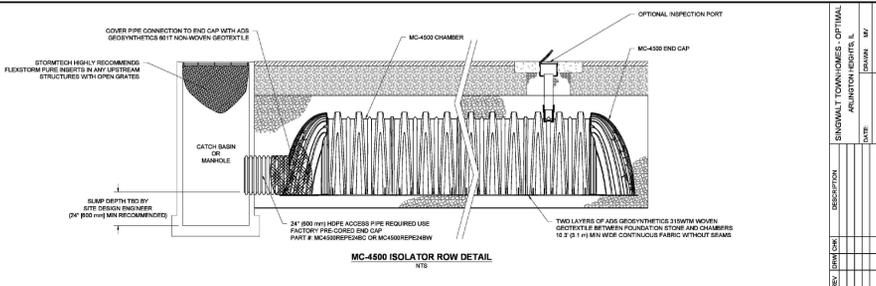


- #### INSPECTION & MAINTENANCE
- INSPECT ISOLATOR ROW FOR SEDIMENT:
 - REMOVE/REPLACE ONLY IN CASE OF SEDIMENT.
 - REMOVE AND CLEAN ISOLATOR ROW AS NECESSARY.
 - USING A FLASHLIGHT AND STACK ROD, MEASURE DEPTH OF SEDIMENT AND RECORD ON MAINTENANCE LOG.
 - LOWER A CAMERA INTO ISOLATOR ROW FOR VISUAL INSPECTION OF SEDIMENT LEVELS (OPTIONAL).
 - IF SEDIMENT AT OR ABOVE 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
 - ISOLATOR ROWS:
 - INSPECT FOR CRACKS, DISPLACEMENTS, OR DEFORMATIONS OF ISOLATOR ROWS.
 - USING A FLASHLIGHT, INSPECT DOWN THE ISOLATOR ROW THROUGH OUTLET PIPE.
 - IF SEDIMENT AT OR ABOVE 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
 - FOLLOW DOWN ISOLATOR ROW FOR CONFIRMED SPACE ENTRY IF ENTERING MANHOLE. IF SEDIMENT AT OR ABOVE 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
 - CLEAN OUT ISOLATOR ROW USING THE SETBACK PROCESS:
 - REMOVE/REPLACE ONLY IN CASE OF SEDIMENT.
 - APPLY MULTIPLE PHASES OF SETBACK UNTIL BACKFLOW WATER IS CLEAN.
 - RECALL STRUCTURE SUMP AS REQUIRED.
 - REPLACE ALL COVERS, GRATES, TIEBARS, AND LIDS. RECORD OBSERVATIONS AND ACTIONS.
 - INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE STORMTECH SYSTEM.
- NOTES:
- INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
 - CONDUCT JETTING AND VACUUMING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

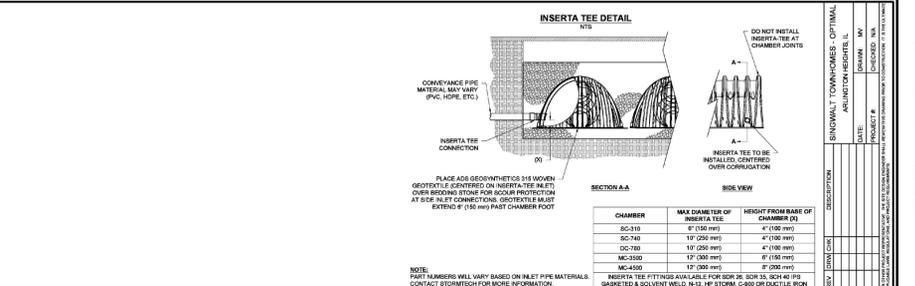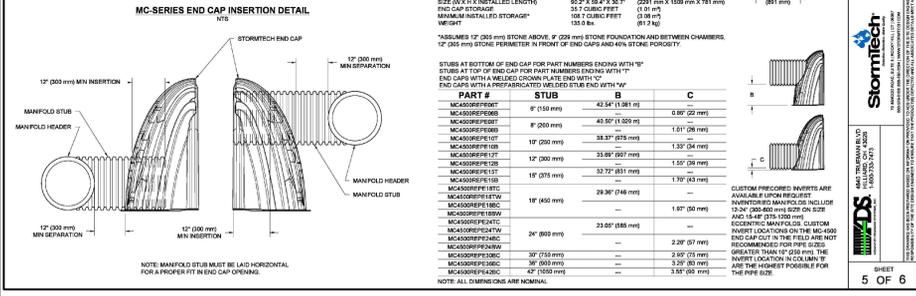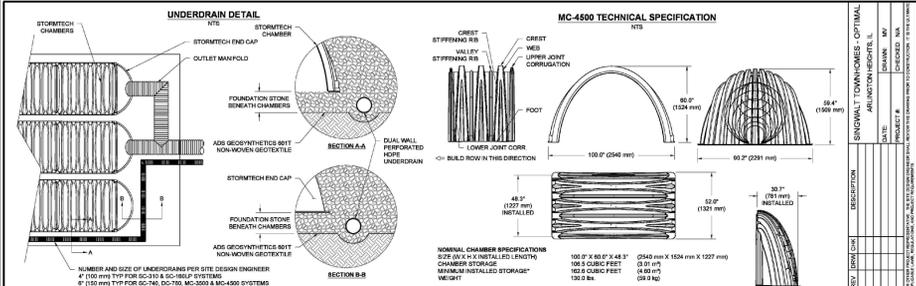

CHAMBER	MAX DIAMETER OF INSERTED TEE	HEIGHT FROM BASE OF CHAMBER (H)
SC-10	8" (200 mm)	4" (100 mm)
SC-16	12" (300 mm)	4" (100 mm)
SC-24	18" (450 mm)	4" (100 mm)
MC-300	12" (300 mm)	4" (100 mm)
MC-450	12" (300 mm)	4" (100 mm)

NOTES:

- PART NUMBERS WILL VARY BASED ON INLET PIPE MATERIALS. CONTACT STORMTECH FOR MORE INFORMATION.
- INSERT TEE FITTINGS AVAILABLE FOR 24" (600 mm) SUMP, 24" (600 mm) DUCTILE IRON.

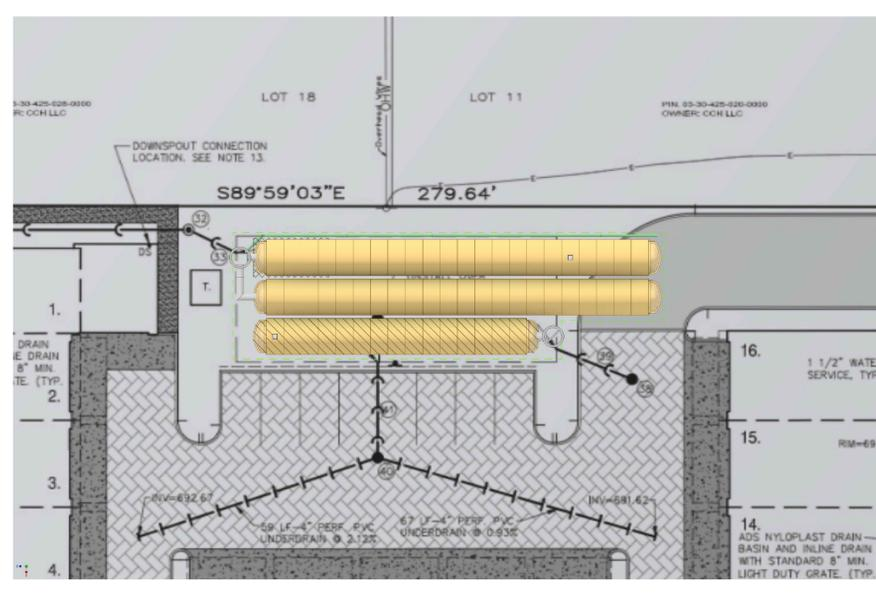

BTL™-40

Double Scrim RPE

DESCRIPTION	VALUE	TEST METHOD
DESCRIPTION	BLACK 15 X 16 COUNT PER INCH	
FABRICATION & WAREHOUSE	PRINEVILLE, OREGON	
WEIGHT	18.5 OZ./SQ.YD. (+/-5%)	ASTM D751
THICKNESS	40 MIL (+/-10%)	ASTM D1777
COATING THICKNESS	2.5 MIL EACH (+/-5%)	
TENSILE STRENGTH (GRAB METHOD)	MD 680 LBS. TO 680 LBS.	ASTM D5934
(STRIP METHOD)	MD 460 LBS. TO 460 LBS.	ASTM D5935
TEAR STRENGTH (TONGUE METHOD)	MD 140 LBS. TO 135 LBS.	ASTM D5884
BURSTING STRENGTH (MULLER BURST)	1300 PSI	ASTM D3786
HYDROSTATIC RESISTANCE	0.31 gal/m ² -24hr (0.04 perms)	ASTM E96
PUNCTURE RESISTANCE	685PSI	ASTM D751
CBR STATIC RESISTANCE	350 LBS	ASTM D4833
LOW TEMPERATURE COLD CRACK	2356 lb (10,461 N)	ASTM D4241
PERMEABILITY	<0.5 x 10 ⁻¹⁰ CM/SEC	ASTM D1216
CARBON BLACK CONTENT	3.1%	ASTM D4218
DIMENSIONAL STABILITY	MD -3.8% TO -1.8%	ASTM D1204
HP-DIT	3048 minutes	ASTM D5885
UV RESISTANCE	>100% STRENGTH RETAINED AFTER 2000 HRS.	ASTM G-154

ALL DATA IS DRAWN FROM U.S. TESTING AND PRECISION LABORATORIES. AVAILABLE ON REQUEST.

RWG Engineering, LLC




Civil Engineering • Real Estate Consulting • Project Management

975 E. 22nd St, Suite 400
Wheaton, IL 60189
630.480.7889
www.rwg-engineering.com

PROJECT NO. 42905219
DATE 04/12/19
SCALE NONE
PROJ. MGR. RWG
PROJ. ASSOC. MRM
DRAWN BY TLM

SHEET 10 OF 10

*NOTE: STORMTECH SYSTEM TO BE WATERTIGHT. USE OF BTL LINER IS REQUIRED.

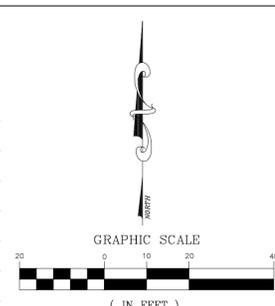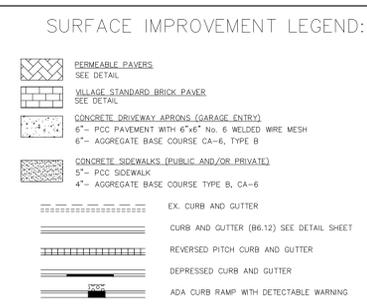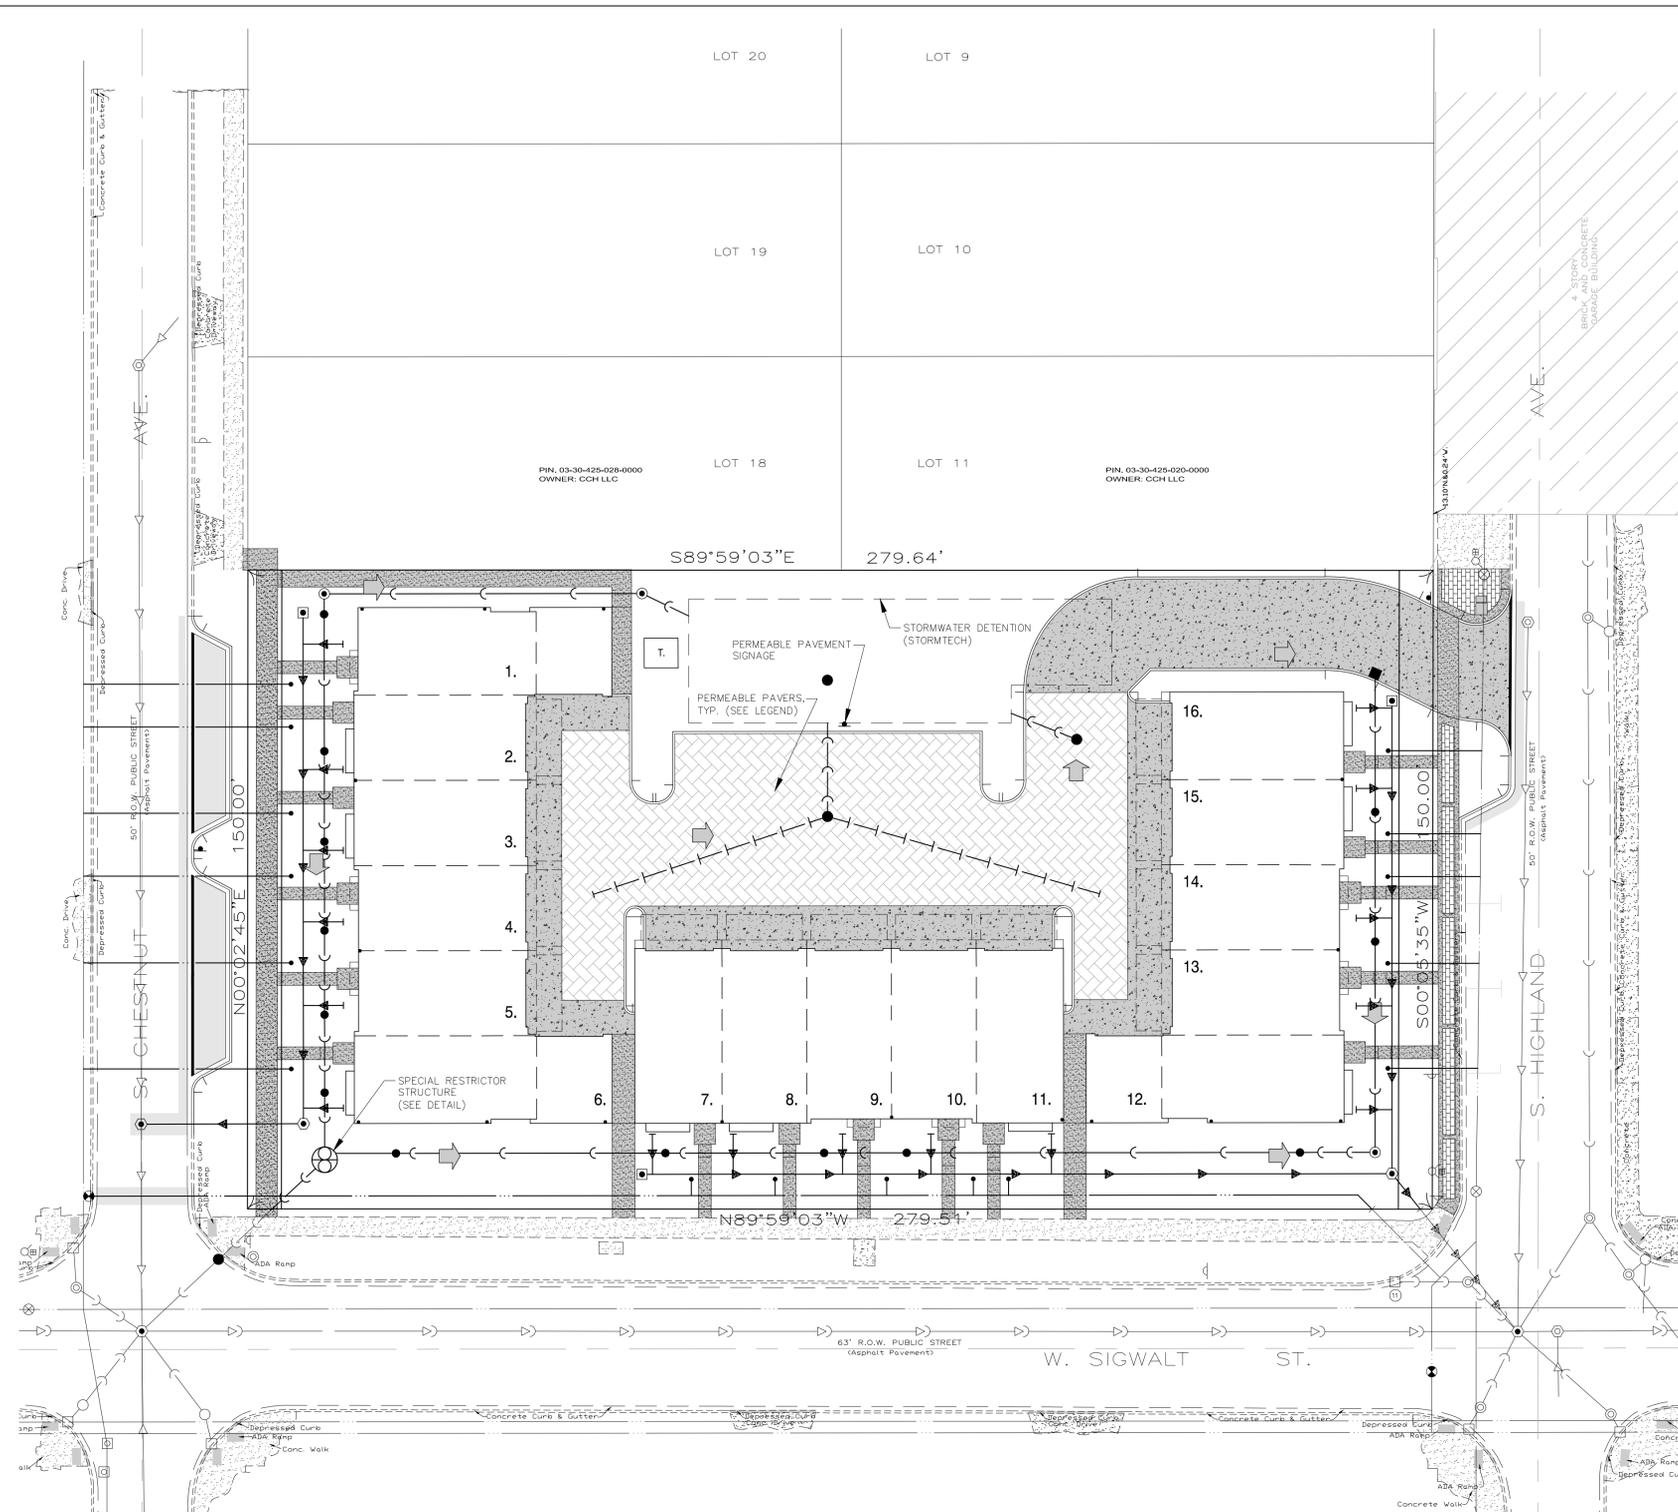

SITE DATA:

EXISTING ZONING: VC-PD (VILLAGE CENTER - PLANNED DEVELOPMENT)
 TOTAL PROPERTY SIZE BEFORE DEDICATED ROW= 41,939 S.F. (0.963 AC)
 TOTAL PROPERTY SIZE AFTER DEDICATED ROW= 39,539 S.F. (0.908 AC)

PROPOSED SITE CONDITIONS:

IMPERVIOUS:
 PROPOSED BUILDING IMPERVIOUS FOOTPRINT = 14,356 S.F.
 SIDEWALK/CURB/PAVED AREAS = 7,000 S.F.
 TOTAL IMPERVIOUS AREA = 21,356 S.F. (54%)

PERVIOUS:
 PERMEABLE PAVEMENT AREA = 5,920 S.F.
 PROPOSED GREENSPACE = 12,263 S.F.
 TOTAL PERVIOUS AREA = 18,183 S.F. (46%)

PROPOSED PARKING SUMMARY (ONSITE AND ADJACENT ROW)

REGULAR STALLS (ON-SITE) = 8
 REGULAR STALLS (ADJACENT ROW) = 3
 TOTAL STALLS PROVIDED = 11

MAINTENANCE PLAN

THE OWNER OF THE SIGWALT 16, 550 ARLINGTON, LLC WITH FACILITIES AS SHOWN ON THIS EXHIBIT (EXHIBIT R), SHALL ASSUME RESPONSIBILITY FOR THE FOLLOWING PERPETUAL MAINTENANCE ACTIVITIES:

- General**
 Regular inspections and routine maintenance of general areas shall be performed on a monthly or as-needed basis. Specific items of concern include:
 - Litter and debris shall be controlled
 - Landscaped areas shall be maintained with regular mowing and restored with appropriate seeding/vegetation as necessary
 - Accumulated sediment shall be disposed of properly, along with any wastes generated during maintenance operations
 - Riprap areas shall be repaired with the addition of new riprap, as necessary, of similar size and shape
 - Roads shall be swept, vacuumed and/or washed on a regular basis

- Stormwater Management Facilities**
 All components of the stormwater management facilities shall be checked monthly between March and November and maintained as necessary to ensure proper performance. It is critical that all inlets and outflows to the detention facility are clean and performing as designed. In addition, the design volume of the detention facility shall also be maintained. Inspections for the following specific items should be conducted monthly between March and November:
 - Side Slopes/Embankment/Emergency Overflow Structure
 - Inspect embankments for settlement and erosion
 - Remove woody growth from the embankment
 - Any breaks, hire Registered Professional Engineer for design resolution
 - Seed and sod any eroded areas
 - Signs of piping (leakage) or seepage, repair
 - Stabilize emergency overflow structure if erosion observed
 - Remove obstructions blocking emergency overflow spillway

- Vegetated Areas**
 - Regular mowing to control vegetation, no cutting of native vegetation
 - Need for planting, reseeding or sodding. Supplement alternative native vegetation if a significant portion has not established (50% of the surface area).
 - Reseed with alternative grass species if original grass cover has not successfully established.
 - Evidence of grazing, motorbikes or other vehicles, repair
 - Check for invasive vegetation, remove where possible
 - All vegetation must be maintained per the approved planting plan

- Outlet Control Structure**
 - Inspect restrictor and remove debris if clogged or discharge reduced
 - Remove accumulated sediment at outlet
 - Scour and erosion at outlet, repair and reseed
 - Any ice damage to outlet of pipe, repair if necessary
 - Condition of trash racks, remove debris
 - Outlet channel conditions downstream

- Access for Maintenance Equipment**
 - Remove any obstructions placed in maintenance easements
- Safety Features**
 - Access controls to hazardous areas
 - Fences
 - Loose or damaged posts
 - Loose or broken wires
 - Condition of gates
 - Signs

- Detention Volume**
 - Inspect all stormwater detention facilities to ensure that the constructed volume for detention is maintained. No sediment, topsoil, or other dumping into the facility shall be allowed. Specific locations in the stormwater management system, designed to accumulate sediment, shall be dredged as necessary to prevent sediment from reaching the invert of any gravity outlet pipe.

- Volume Control Facility**
 Routine inspections and maintenance of volume control facilities shall be performed by the Owner on a yearly or as-needed basis. Specific items of concern include:
 - Facility shall be inspected yearly using the monitoring well to verify the system is functioning properly.
 - Surface of permeable pavement shall be cleaned with low pressure power washer.
 - Accumulated sediment from surface shall be vacuumed out and disposed of properly.
 - Appropriate signage shall be repaired if damaged or illegible.

- Stormwater Collection System**
 The Owner shall perform monthly inspections of all components of the stormwater collection system. The monthly inspection shall occur between March and November and include the following specific areas of concern:




- Storm Inlets/Manholes**
 - Remove accumulated leaves and other debris from grates
 - Reset covers/lids on as-needed basis
 - Remove accumulated sediment from manhole bottom when 50% of sump is filled
- Storm Sewers/Culverts**
 - Visually inspect pipes by removing manhole lids, make repairs as necessary
 - Storm sewers and culverts shall be checked for siltation deposits at inlets, outlets, and within the conduit, clean out as necessary
 - Restore riprap at outfalls if eroded observed
 - Restore riprap at outfalls
 - Replant and reseed any eroded areas

- Overland Flow Routes (Ditches/Swales)**
 - Annual visual inspections shall be performed that verify the design capacity of the overland flow routes is maintained. The slope and cross-sectional area of the ditch/swale shall be verified during this inspection
 - Remove any obstructions that have been placed in the drainage path
 - Seed and sod any eroded areas
 - Restore riprap as necessary
 - Upgrade to provide positive drainage as necessary
 - Regular mowing to control vegetation

- Qualified Sewer Construction**
 - Perform manhole inspections once every five years, make repairs as necessary.
 - Perform sewer inspections once every five years, make repairs as necessary.
 - Perform regular cleaning so that each sewer segment is clean once every five years.
 - Remove any obstructions placed in maintenance easements that may impede maintenance equipment access.

- Stormtech Inspection and Maintenance Plan**
 (Step 1) Inspect Isolator row for sediment
 A. Inspection ports (if present)
 A.1. Remove/Open lid on rhyolite inline drain
 A.2. Remove and clean Reaction Filter if installed
 A.3. Using a flashlight and stadia rod, measure depth of sediment and record on maintenance log
 A.4. Lower a camera into Isolator row for visual inspection of sediment levels (optional)
 A.5. If sediment is 0.1" or above, 3" (80 mm) proceed to step 2, if not, proceed to step 3.
 (Step 2) Clean out Isolator row using the jetvac process
 A. fixed culvert cleaning nozzle with rear facing spread of 45" (1.1m) or more is preferred
 A. Apply multiple passes of jetvac until backflush water is clean
 B. Vacuum structure sump as required
 (Step 3) Replace all covers, Grates, Filters, and Lids; record observations and actions.
 (Step 4) inspect and clean basins and manholes upstream of the stormtech system.

- NOTES:**
 1. Inspect every 6 months during the first year of operation. Adjust the inspection interval based on previous observations of sediment accumulation and high water elevations.
 2. Conduct jetting and watering annually or when inspection shows that maintenance is necessary.

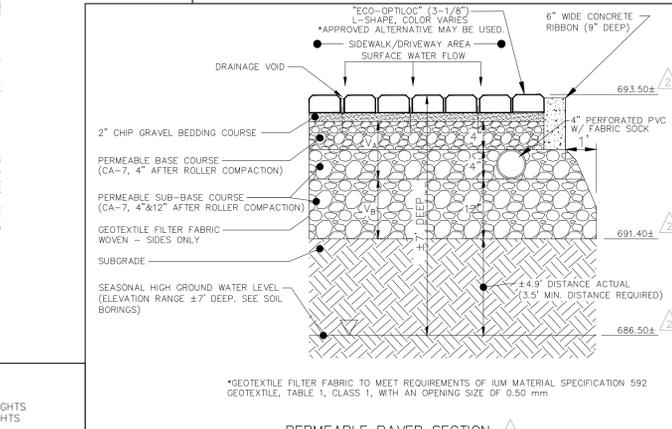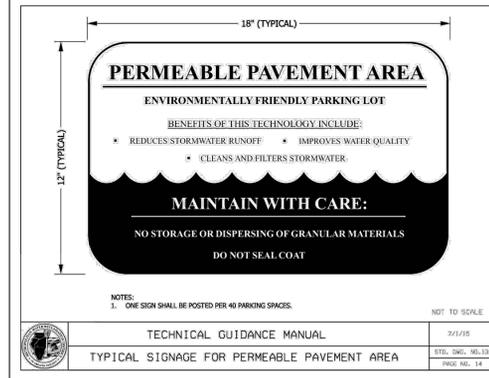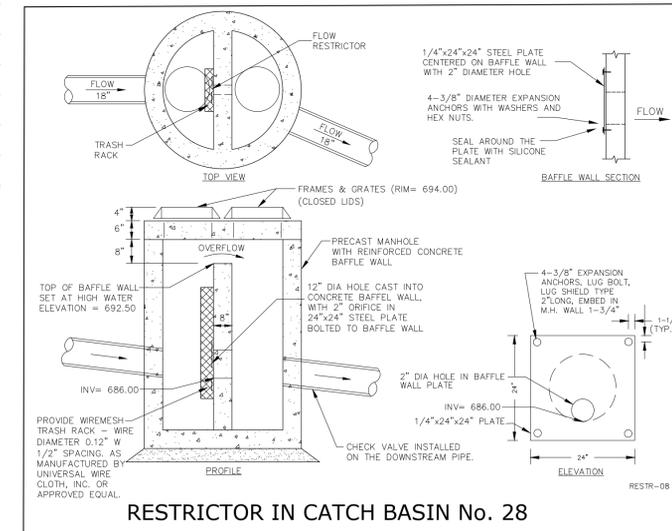

- NOTES:**
 1. OFFSET A MINIMUM OF 10 FEET FROM FOUNDATIONS UNLESS WATERPROOFED, 20 FEET FROM SANITARY SEWERS, 20 FEET FROM ROADWAY GRAVEL SHOULDER AND 100 FEET FROM POTABLE WATER WELLS OR SEPTIC TANKS.
 2. ANODE INSTALLATION ON SLOPES GREATER THAN 15 TO 1 AND ABOVE COMPACTED FILL.
 3. WOVEN GEOTEXTILE FABRIC SHALL MEET REQUIREMENTS OF LUM MATERIAL SPECIFICATION 592 GEOTEXTILE, TABLE 1, CLASS 1, WITH AN APPARENT OPENING SIZE OF 0.50 MM.
 4. STONE STORAGE OPTIONS ARE CA-7, DISTRICT VULCAN MIX, OR APPROVED ALTERNATE. NO RECYCLED MATERIALS.
 5. MINIMUM DISTANCE OF 2 FEET (3.5 FEET IN COMBINED SEWER AREAS) BETWEEN BOTTOM OF BMP AND SEASONALLY HIGH GROUNDWATER LEVEL.
 6. UNDERDRAINS ARE REQUIRED IN TYPICAL CLAYEY SOILS WHERE INFILTRATION RATES ARE LESS THAN 0.5 INCH/ HOUR. MAXIMUM OF 1 UNDERDRAIN PER 30 FEET. PROVIDE A SOIL REPORT DOCUMENTING NATIVE INFILTRATION RATE TO FOREGO UNDERDRAINS.
 7. MINIMUM UNDERDRAIN BEDDING OF TWO INCHES, MAXIMUM OF 12 INCHES.
 8. ONE OBSERVATION WELL REQUIRED PER 40,000 SQUARE FEET OF SURFACE AREA.
 9. FOLLOW THE REQUIRED PRETREATMENT MEASURES LISTED ON THE VOLUME CONTROL PRETREATMENT MEASURES DETAIL.
 10. MAINTENANCE REQUIREMENTS INCLUDE ANNUAL VACUUMING AND LOW-PRESSURE POWER WASHING OF PAVEMENT SURFACE. ADJACENT VEGETATED AREAS SHALL BE WELL MAINTAINED. BARE SPOTS AND ERODED AREAS SHALL BE REPLANTED AND STABILIZED IMMEDIATELY. DO NOT SEAL COAT.
 11. APPROPRIATE SIGNAGE REQUIRED FOR FACILITY, REFER TO THE SIGNAGE FOR PERMEABLE PAVEMENT DETAIL.

PROJECT SITE SUMMARY

PROPERTY LEGAL DESCRIPTION: SEE NOTE ON PLAN
 PROPERTY ADDRESS: 45 SOUTH CHESTNUT AVENUE, ARLINGTON HEIGHTS, IL
 PROPERTY INDEX NUMBER(S): SEE NOTE ON PLAN
 TOTAL CONTIGUOUS OWNERSHIP: 0.908 ACRES
 PROJECT AREA: 0.908 ACRES

DETENTION AND VOLUME CONTROL SUMMARY

	EXISTING (AC-FT)	PROVIDED (AC-FT)	PROVIDED (AC-FT)
VOLUME CONTROL	0	0.0408	* 0.0652
DETENTION	0.26	0.0	0.26

* EXCESS 0.0244 AC-FT OF VOLUME CONTROL APPLIED TO VILLAGE DETENTION REQUIREMENT.

EXISTING PROPERTY DATA

ADDRESS: 37-45 S. CHESTNUT AVE, ARLINGTON HEIGHTS
 36-40 S. HIGHLAND AVE, ARLINGTON HEIGHTS

EXISTING ZONING: VC-PD (VILLAGE CENTER - PLANNED DEVELOPMENT)

TOTAL SITE AREA BEFORE DEDICATED ROW: 41,939 S.F. (0.963 AC)
 TOTAL SITE AREA AFTER DEDICATED ROW: 39,539 S.F. (0.908 AC)

PIN: 03-30-425-012-0000
 03-30-425-013-0000
 03-30-425-014-0000
 03-30-425-021-0000
 03-30-425-022-0000
 03-30-425-023-0000

LEGAL DESCRIPTION: LOTS 12, 13, 14, 15, 16 AND 17 IN BLOCK 2 IN A SUBDIVISION OF LOTS 26, 27, 28 AND 29 IN ASSESSOR'S SUBDIVISION OF SECTION 30, TOWNSHIP 42 NORTH, RANGE 11 EAST OF THE THIRD PRINCIPAL MERIDIAN, IN COOK COUNTY, ILLINOIS

UTILITY LEGEND

	EXISTING	PROPOSED
SANITARY MANHOLE	⊙	⊙
STORM MANHOLE	⊙	⊙
CATCH BASIN	○	●
INLET	□	■
PRECAST FLARED END SECTION	▷	▷
SANITARY SEWER	—	—
STORM SEWER	—	—

DRAWN BY: _____
 REVISIONS: _____
 DATE: _____

SIGWALT TOWNHOMES
ARLINGTON HEIGHTS, ILLINOIS
EXHIBIT R - MAINTENANCE PLAN

975 E. 22nd St, Suite 400
 Wheaton, IL 60189
 630.480.7889
 www.rwg-engineering.com

RWG Engineering, LLC
 Civil Engineering • Real Estate Consulting • Project Management

PROJECT NO. 42905219
 DATE 04/05/19
 SCALE 1"=20'
 PROJ. MGR. RWG
 PROJ. ASSOC. MRM
 DRAWN BY. TLM
 SHEET 1 OF 1